



Liberty
933 Eloise Avenue
South Lake Tahoe, CA 96150
Tel: 800-782-2506
libertyutilities.com

December 10, 2024

Leslie Palmer, Director
Safety and Enforcement Division
California Public Utilities Commission
505 Van Ness Avenue
San Francisco, CA 94102

Re: Liberty Post-Event Report on Public Safety Power Shutoff (“PSPS”) Event on November 22, 2024

Dear Director Palmer:

Liberty Utilities (CalPeco Electric) LLC (“Liberty”) respectfully submits the attached report regarding its PSPS event on November 22, 2024, in compliance with PSPS Post-Event Reporting requirements in Resolution ESRB-8 and California Public Utilities Commission (“CPUC”) Decision (“D.”) 19-05-042, D.20-05-051, D.21-06-014 and D.21-06-034. This report has been verified by an officer of Liberty in accordance with Rule 1.11 of the Commission’s Rules of Practice and Procedure.

Sincerely,

A handwritten signature in black ink, appearing to read "Jordan Parrillo".

Jordan Parrillo
Manager, Regulatory Affairs
Liberty

cc: ESRB_CompplianceFilings@cpuc.ca.gov

Ronald DeMayo, Ronald.DeMayo@cpuc.ca.gov

Anthony Noll, Anthony.Noll@cpuc.ca.gov



Liberty
933 Eloise Avenue
South Lake Tahoe, CA 96150
Tel: 800-782-2506
libertyutilities.com

**Liberty Utilities (CalPeco Electric) LLC
Public Safety Power Shutoff (“PSPS”) Post-Event Reporting for
November 22, 2024, PSPS Event**

**Submitted to:
California Public Utilities Commission
Director of the Safety and Enforcement Division
December 10, 2024**



Liberty
933 Eloise Avenue
South Lake Tahoe, CA 96150
Tel: 800-782-2506
libertyutilities.com

Table of Contents

1	Executive Summary	1
2	Decision-Making Process	4
3	Description of the Event	17
4	Damage and Hazards to Overhead Facilities	20
5	Notifications	22
6	Local and State Public Safety Partner Engagement	27
7	Complaints and Claims	32
8	Power Restoration	33
9	Community Resource Centers	34
10	Mitigations to Reduce Impact to Customers	37
11	Lessons Learned from this Event	38
12	Other Relevant Information	39
13	Officer Verification	40
14	Appendix A – Customer Notifications	
15	Appendix B – Public Safety Partner Notifications	
16	Appendix C – CPUC Notifications	
17	Appendix D - PSPS Event Data Workbook (Excel File)	

1 Executive Summary

1.1 Brief description of the PSPS event starting from the time when the utility's Emergency Operation Center is activated until service to all customers have been restored.

Liberty Utilities (CalPeco Electric) LLC ("Liberty") submits this post-event report in compliance with California Public Utilities Commission's PSPS post event requirements. The PSPS event occurred on November 22, 2024, and impacted customers in the Markleeville, Woodfords, and Desolation Hotel (Hope Valley) areas in Alpine County and the Topaz, Coleville, and Walker areas of Mono County. A summary of the timeline for this event is provided below.

In the morning of November 21, 2024, Liberty's fire science experts identified high fire risk for the Muller 1296 circuit and the Topaz 1202 circuit due to high wind gusts and low relative humidity for the Markleeville, Woodfords, and Desolation Hotel (Hope Valley) areas in Alpine County and the Topaz, Coleville, and Walker areas in Mono County. These conditions were forecasted to begin on November 22, 2024, at approximately 5:00 a.m.

In response to this forecasted fire weather, on November 21, 2024, Liberty activated its Emergency Operations Center ("EOC") to monitor the forecasted extreme weather conditions in the aforementioned areas. In addition, Liberty also activated its dedicated PSPS Incident Management Team ("IMT") on November 21, 2024, at approximately 8:00 a.m. to monitor the potential of a de-energization event. Liberty began sending notifications of the potential PSPS to Public Safety Partners ("PSPs"), Critical Facilities and Infrastructure ("CFI") customers and other customers in scope.

On November 22, 2024, at approximately 8:00 a.m., as a result of extreme weather conditions, as discussed below, Liberty de-energized approximately 709 customers in Alpine County. Subsequently, on November 22, 2024, at approximately 1:26 p.m., as a result of extreme weather conditions, as discussed below, Liberty de-energized approximately 355 additional customers in Mono County. The PSPS event concluded on November 22, 2024, at 9:47 p.m. and power was restored to all impacted customers. Liberty's EOC and IMT de-mobilized on November 22, 2024, at approximately 10:00 p.m.

Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

1.2 A table including the maximum numbers of customers notified and actually deenergized; number of counties de-energized; number of tribes de-energized; number of Medical Baseline customers de-energized; number of transmission and distribution circuits de-energized; damage/hazard count; number of critical facilities and infrastructure de-energized. Hazards are conditions discovered during restoration patrolling or operations that might have caused damages or posed an electrical arcing or ignition risk had PSPS not been executed.


Table 1-1: PSPS Event Summary

Total Customers			De-energized				Number of Circuits			Damage/ Hazard Count
PSPS Notified	De- energized	Cancelled	MBL Customers	Number of Counties	Number of Tribes	Critical Facilities and Infrastructure	Transmission De-energized	Distribution Circuits in Scope	Distribution Circuits De- energized	
1,491	1,064	450	12	2	1	35	0	2	2	1

1.3 A PDF map depicting the de-energized area(s).

The map below depicts the areas in Alpine County and Mono County that were impacted by the PSPS event.

Figure 1-1: Map of De-energized Liberty Area, November 22, 2024, PSPS Event

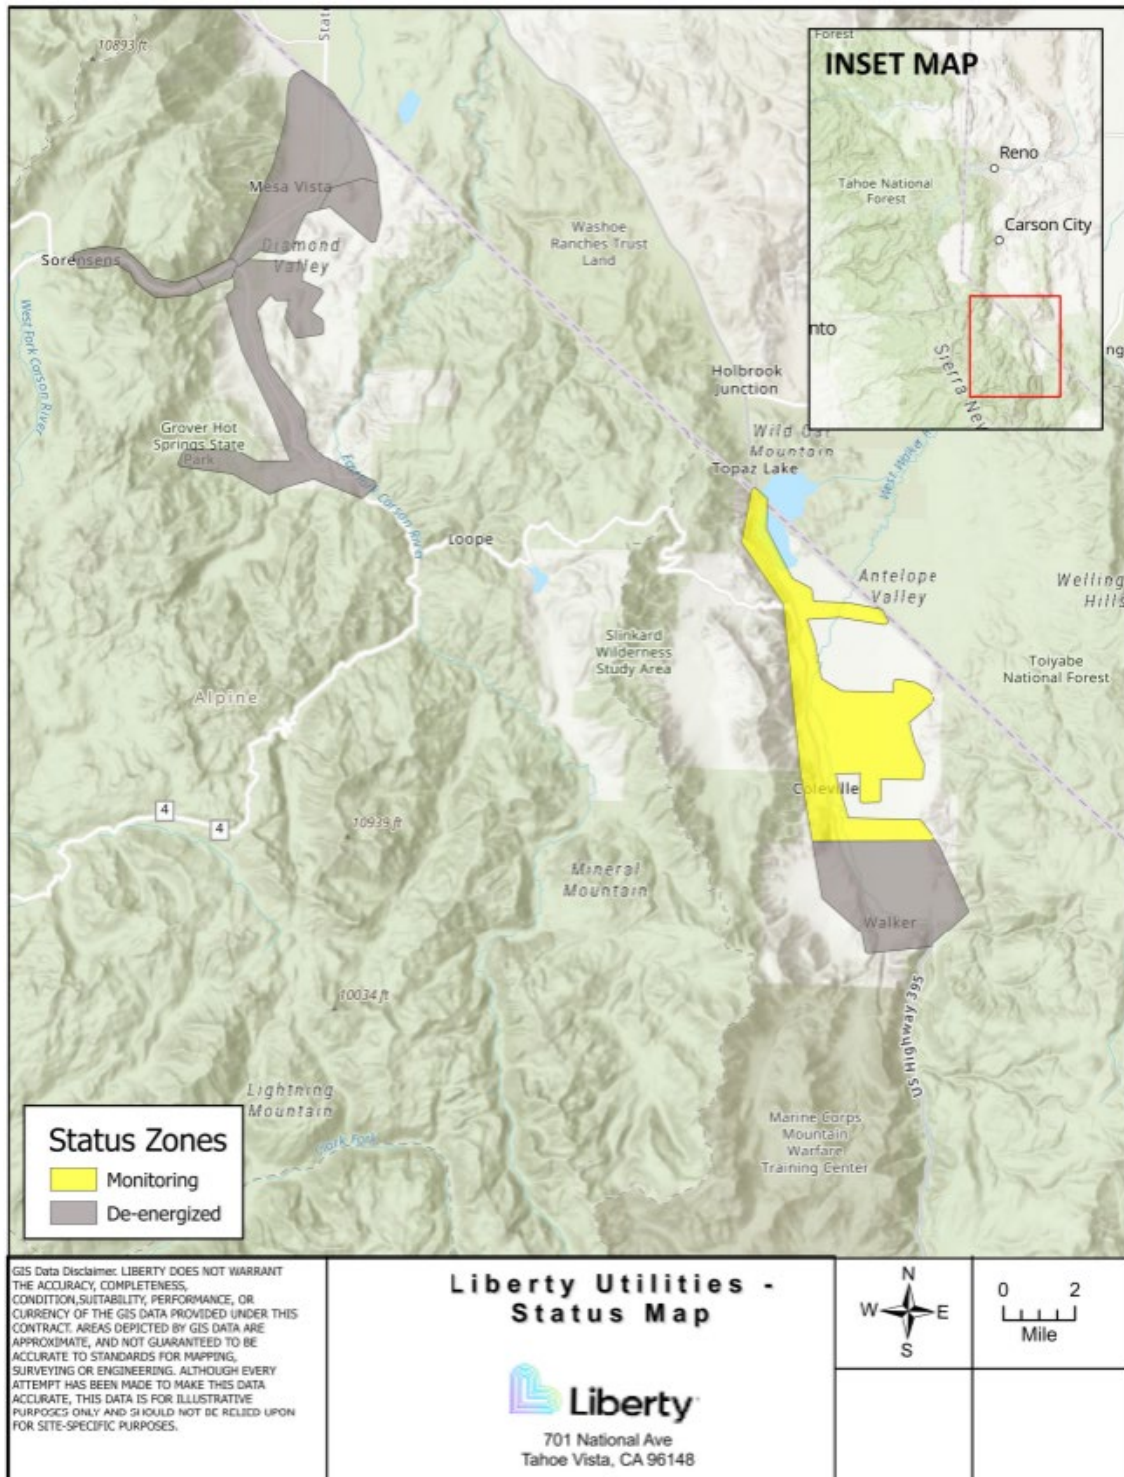

2 Decision-Making Process

2.1 A table showing factors considered in the decision to shut off power for each circuit de-energized, including sustained and gust wind speeds, temperature, humidity, and moisture in the vicinity of the de-energized circuits.

Table 2-1: Factors Considered in Decision to De-Energize

Circuit De-energized	Sustained Wind Speed (mph)	Gust Wind Speed (mph)	Relative Humidity (%)	FFWI 1Hr Average	Live Woody Fuel Moisture	1000hr Fuel Moisture (%)
Muller 1296	36.0	62.0	29.8	77.0	75%	11%
Topaz 1202 R2 and R3	33.4	56.1	17.1	83.8	75%	11%

2.2 Decision criteria and detailed thresholds leading to de-energization including the latest forecasted weather parameters versus actual weather. Also include a PSPS decision-making diagram(s)/flowchart(s) or equivalent along with narrative description.

1. Muller 1296 Circuit

Liberty’s de-energization decision making is based primarily on Composite Risk Index (“CRI”), a forecastable estimate of risk from powerline caused fires. CRI considers sustained and gust wind speed, fuel type, topography, and live & dead fuel moisture. It is cast in terms of a percentage of zone-specific thresholds and is intended to be used as a screening criterion, rather than an explicit threshold. The primary factors considered in the decision were live fuel moisture values in the area and the fire weather forecast for Muller 1296 R3. Sagebrush fuel moisture was measured at 75% moisture content on 11/11/24, just over one week before the event. The table below shows the Muller 1296 R3 zonal average forecast from the 2024-11-22 06z High Resolution Rapid Refresh (“HRRR”) model, along with CRI percent of threshold.

Table 2-2: Muller 1296 zonal average forecast



Time PST	CRI %	Wind speed mph	Wind gust mph	RH %	Temp °F	FFWI -
11/22/2024 6:00	60.1	31.4	54.9	30.9	48.0	66.1
11/22/2024 7:00	65.9	32.6	56.6	31.3	47.7	68.4
11/22/2024 8:00	83.8	36.0	62.0	29.8	49.9	77.0
11/22/2024 9:00	90.5	37.1	61.3	26.6	52.8	82.7
11/22/2024 10:00	65.2	29.8	50.8	24.1	55.1	68.5
11/22/2024 11:00	65.1	31.2	51.2	21.1	57.4	74.6
11/22/2024 12:00	62.4	29.0	47.0	19.6	58.6	70.7
11/22/2024 13:00	65.9	30.6	48.8	19.1	57.9	74.9
11/22/2024 14:00	84.0	35.2	55.8	19.0	56.3	86.2
11/22/2024 15:00	81.2	33.8	54.6	20.0	54.5	81.9
11/22/2024 16:00	69.8	30.8	52.5	21.7	51.8	72.9
11/22/2024 17:00	68.7	28.1	49.8	24.1	49.2	64.3
11/22/2024 18:00	80.6	29.3	53.3	28.4	47.6	63.7
11/22/2024 19:00	84.7	32.6	57.1	37.4	45.6	63.4
11/22/2024 20:00	13.1	28.9	52.2	61.6	41.4	40.6
11/22/2024 21:00	0.0	26.7	49.7	81.8	38.1	21.1
11/22/2024 22:00	0.0	20.8	36.3	84.0	37.4	14.8

When CRI is forecast to approach 100% of that threshold, additional factors are considered to determine whether proactive de-energization is appropriate. These factors include:



- Recent fuel moisture sampling data
- Forecast sustained and gust speed compared to observations
- Field observations, including blowing debris

A comparison of forecast vs. observations is presented below for two weather stations on the Muller 1296 circuit.



Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

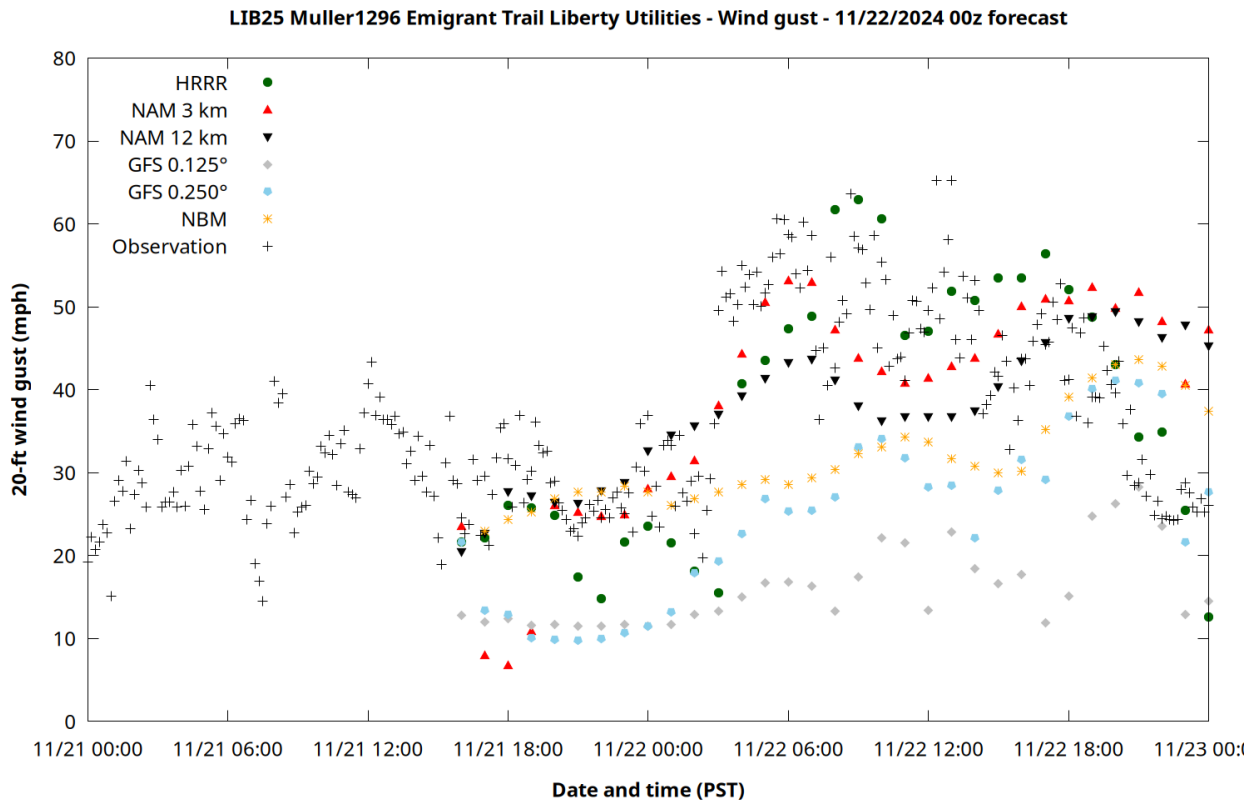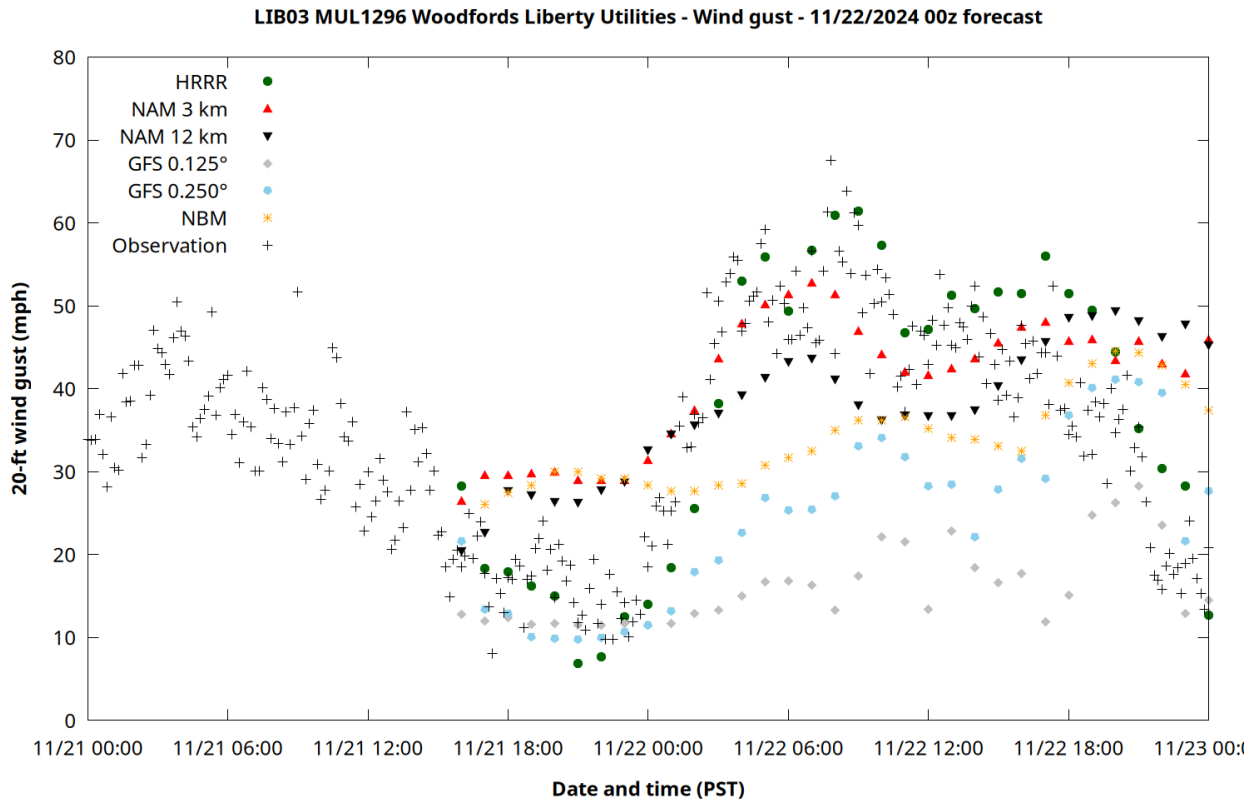

Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

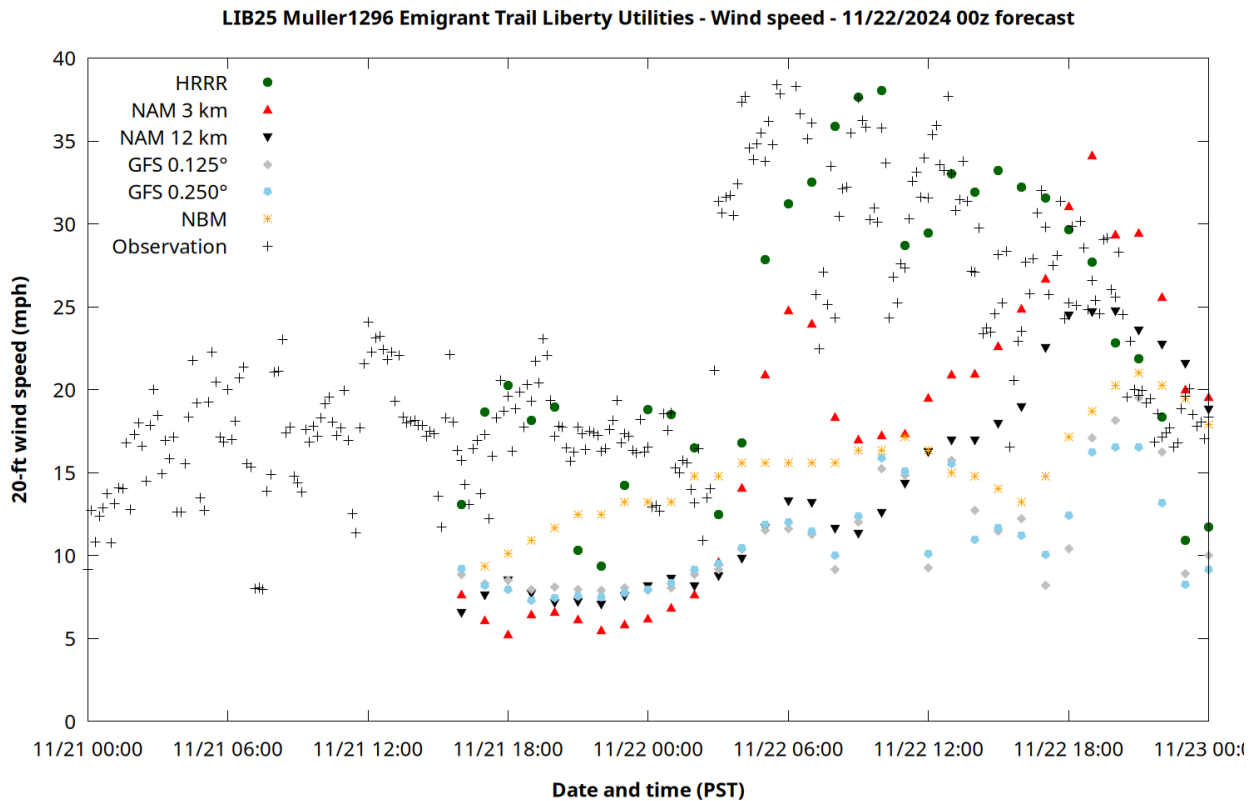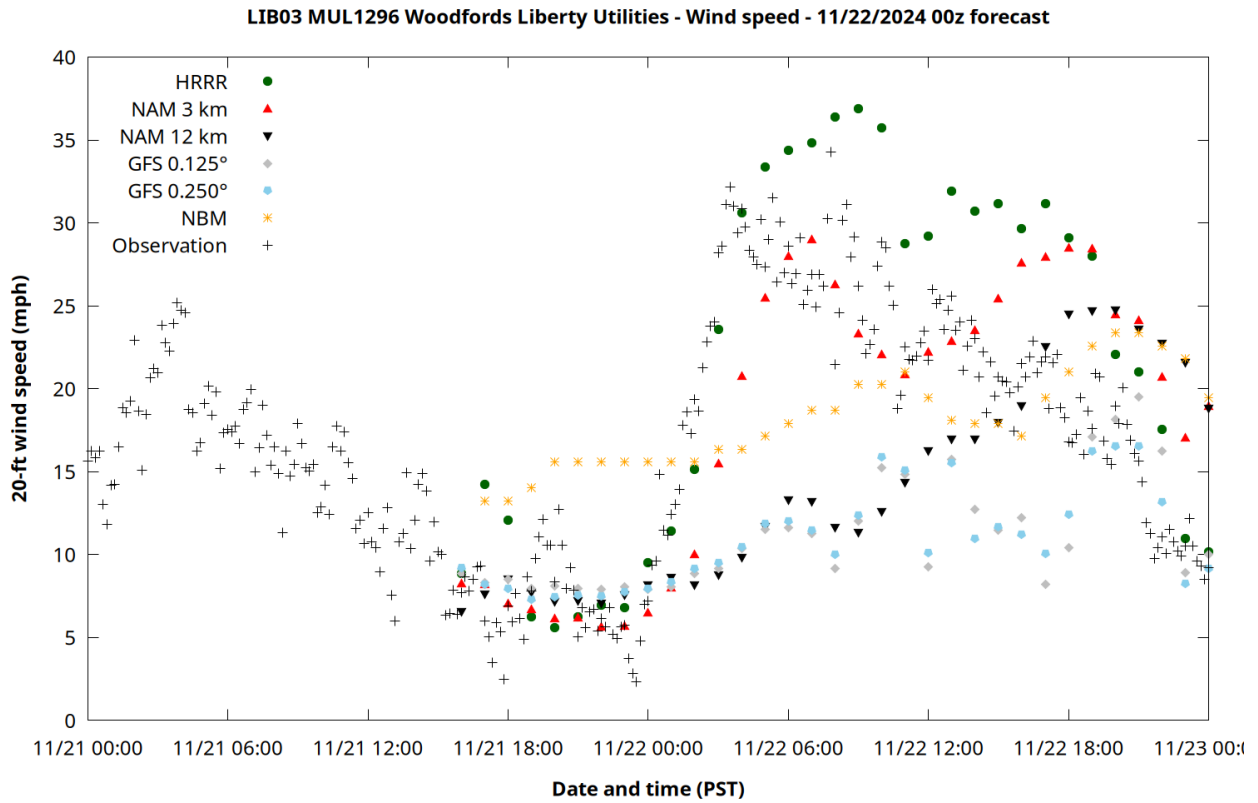


Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

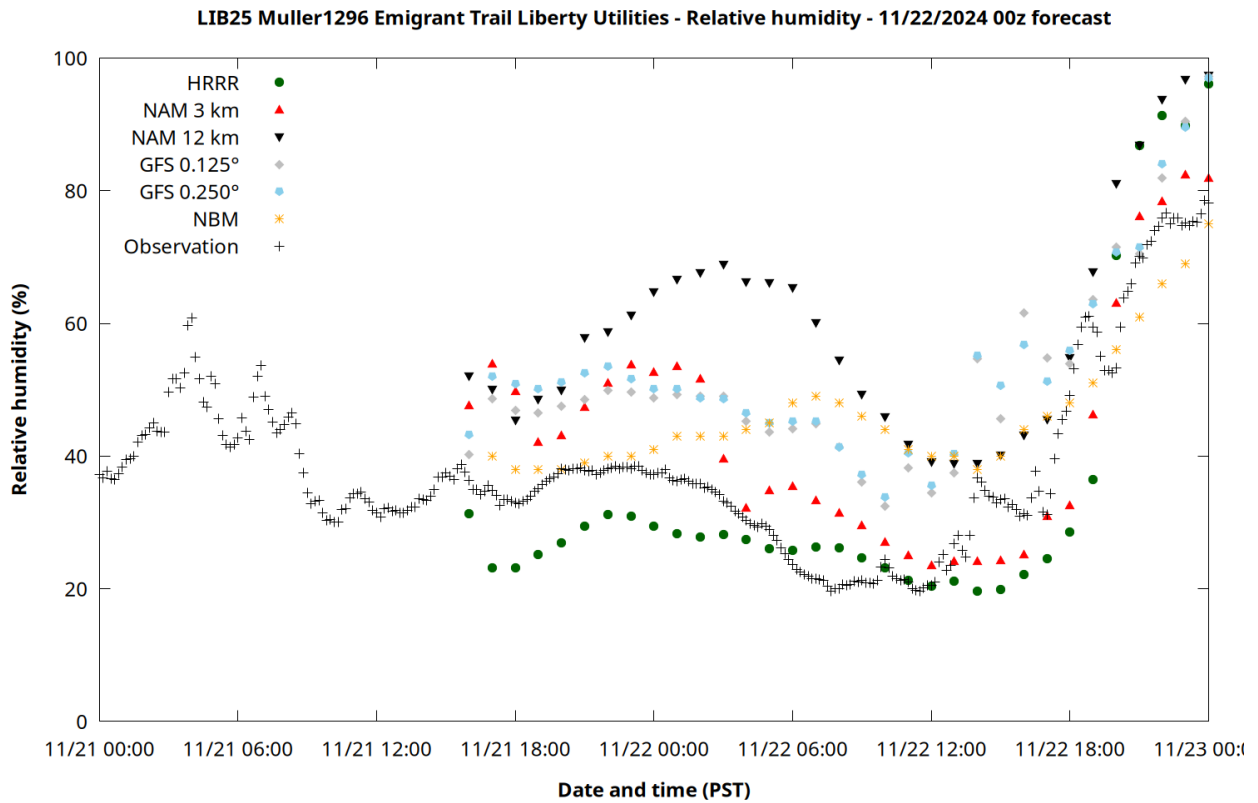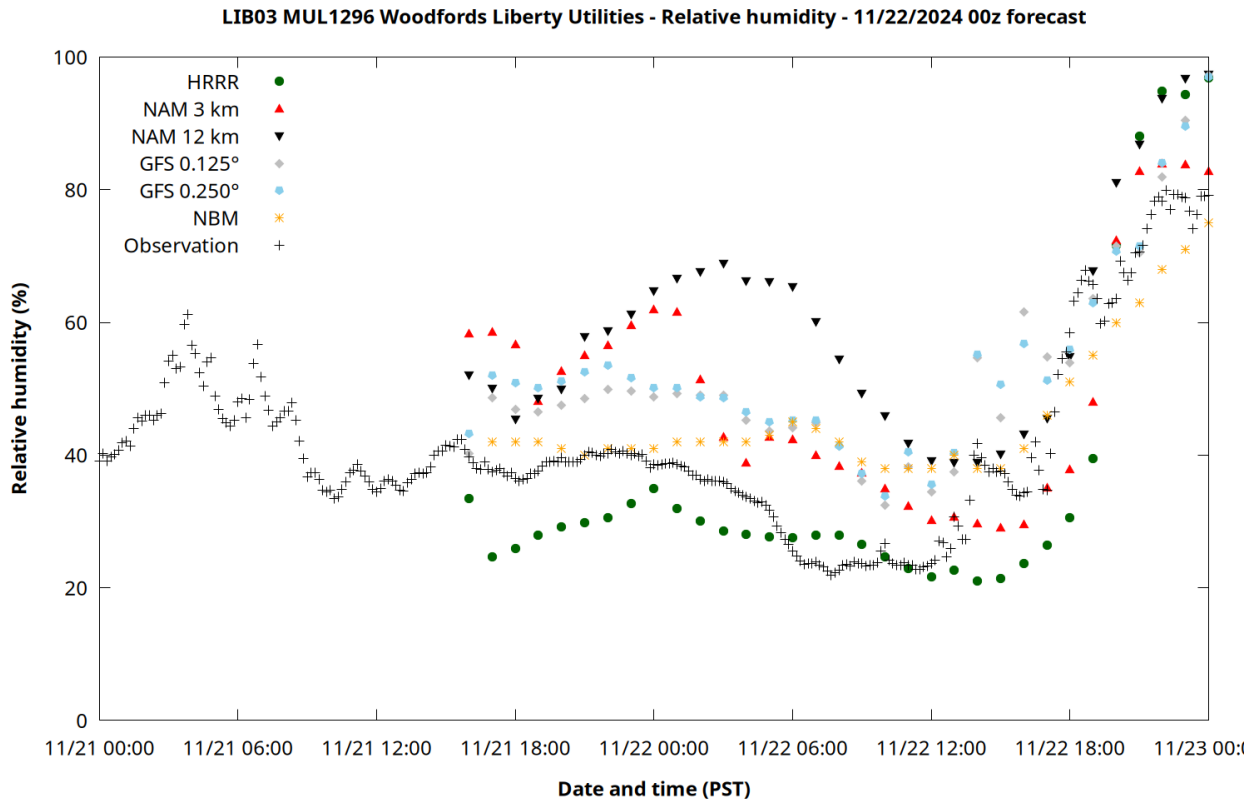


Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

LIB03 MUL1296 Woodfords Liberty Utilities - Temperature - 11/22/2024 00z forecast

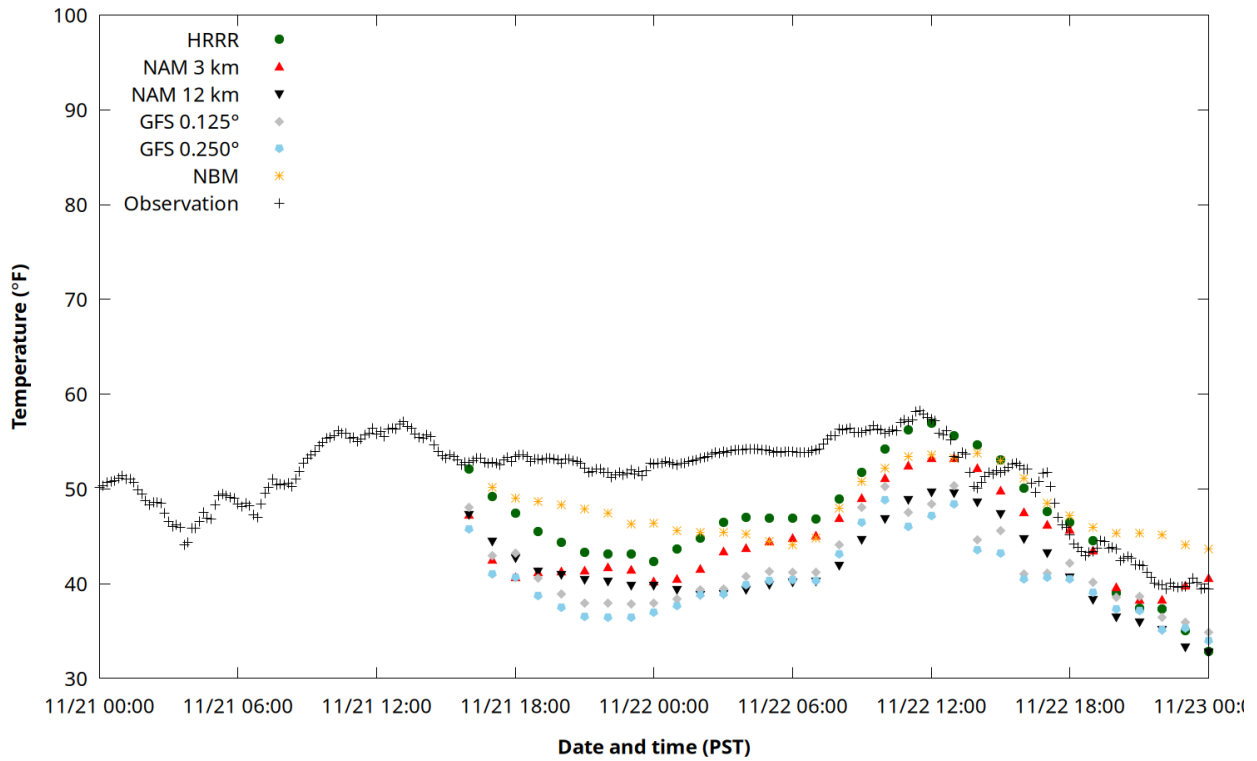

LIB25 Muller1296 Emigrant Trail Liberty Utilities - Temperature - 11/22/2024 00z forecast

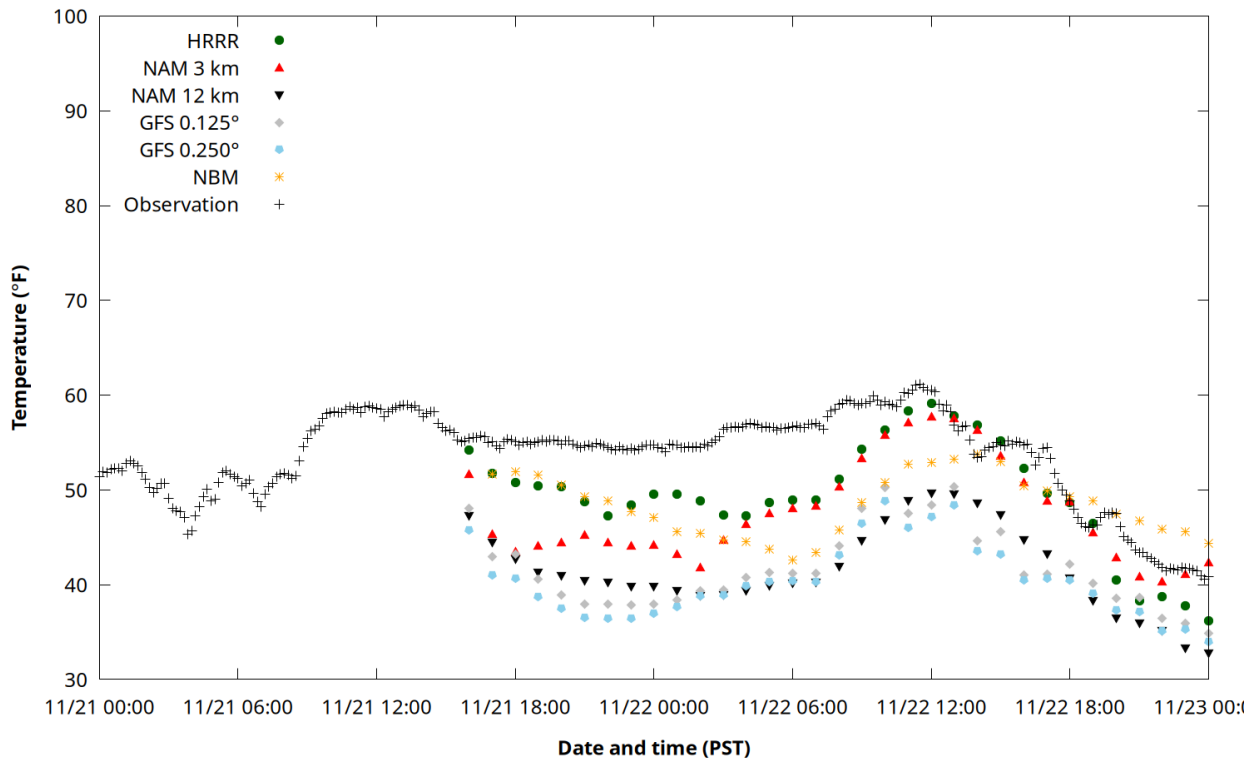

2. Topaz 1202 Circuit:

Liberty’s de-energization decision making is based primarily on CRI, a forecastable estimate of risk from powerline caused fires. CRI considers sustained and gust wind speed, fuel type, topography, and live & dead fuel moisture. It is cast in terms of a percentage of zone-specific thresholds and is intended to be used as a screening criterion, rather than an explicit threshold. The primary factors considered in the decision were live fuel moisture values in the area and the fire weather forecast for the Topaz circuit. Sagebrush fuel moisture was measured at 75% moisture content on 11/11/24, just over one week before the event. The table below shows the Topaz circuit zonal average forecast from the 2024-11-22 06z HRRR model, along with CRI percent of threshold.

Table 2-3: Topaz 1202 zonal average forecast



Time PST	CRI %	Wind speed mph	Wind gust mph	RH %	Temp °F	FFWI -
11/22/2024 6:00	15.8	18.3	27.5	23.5	50.5	42.5
11/22/2024 7:00	20.2	19.3	28.6	24.0	50.0	44.6
11/22/2024 8:00	35.3	20.8	41.4	22.3	53.2	49.1
11/22/2024 9:00	57.5	27.0	55.0	18.9	57.6	66.5
11/22/2024 10:00	73.1	32.8	60.5	17.3	59.6	82.3
11/22/2024 11:00	74.9	33.9	58.0	15.3	61.3	87.2
11/22/2024 12:00	76.9	32.1	53.2	14.3	62.2	83.5
11/22/2024 13:00	84.9	32.0	53.2	15.1	61.4	82.4
11/22/2024 14:00	93.0	34.0	56.3	15.9	59.7	86.7
11/22/2024 15:00	96.6	33.4	56.1	17.1	57.5	83.8
11/22/2024 16:00	99.1	30.3	55.0	19.0	54.2	74.1
11/22/2024 17:00	101.9	29.8	56.6	20.3	51.2	71.5
11/22/2024 18:00	107.5	28.2	57.2	21.4	49.8	66.7
11/22/2024 19:00	114.1	27.2	56.9	22.6	48.5	63.3
11/22/2024 20:00	129.9	33.0	59.8	25.5	47.7	74.3
11/22/2024 21:00	102.6	29.7	57.1	36.9	45.1	58.2
11/22/2024 22:00	57.0	31.4	57.8	58.9	40.9	45.4

When CRI is forecast to approach 100% of that threshold, additional factors are considered to determine whether proactive de-energization is appropriate. These factors include:



- Recent fuel moisture sampling data
- Forecast sustained and gust speed compared to observations
- Field observations, including blowing debris

A comparison of forecast vs. observations is presented below for two weather stations on the Topaz circuit.



Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

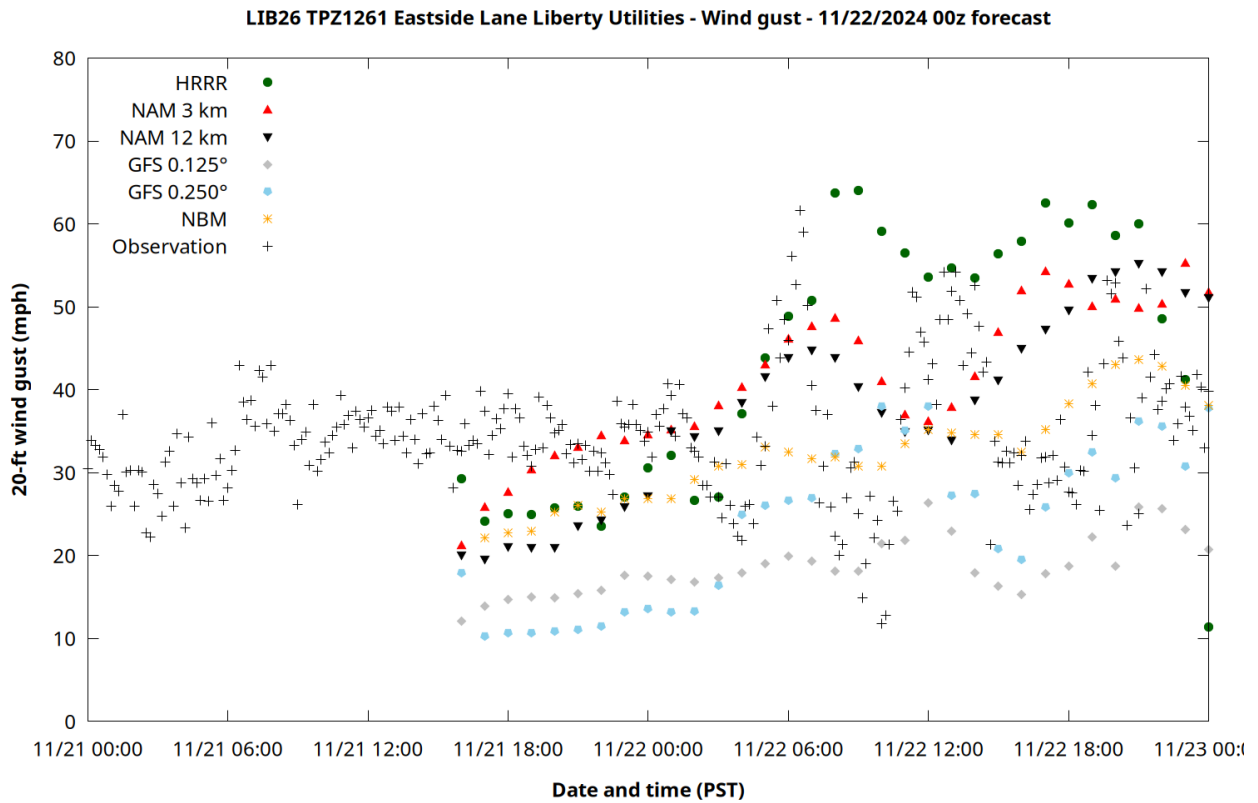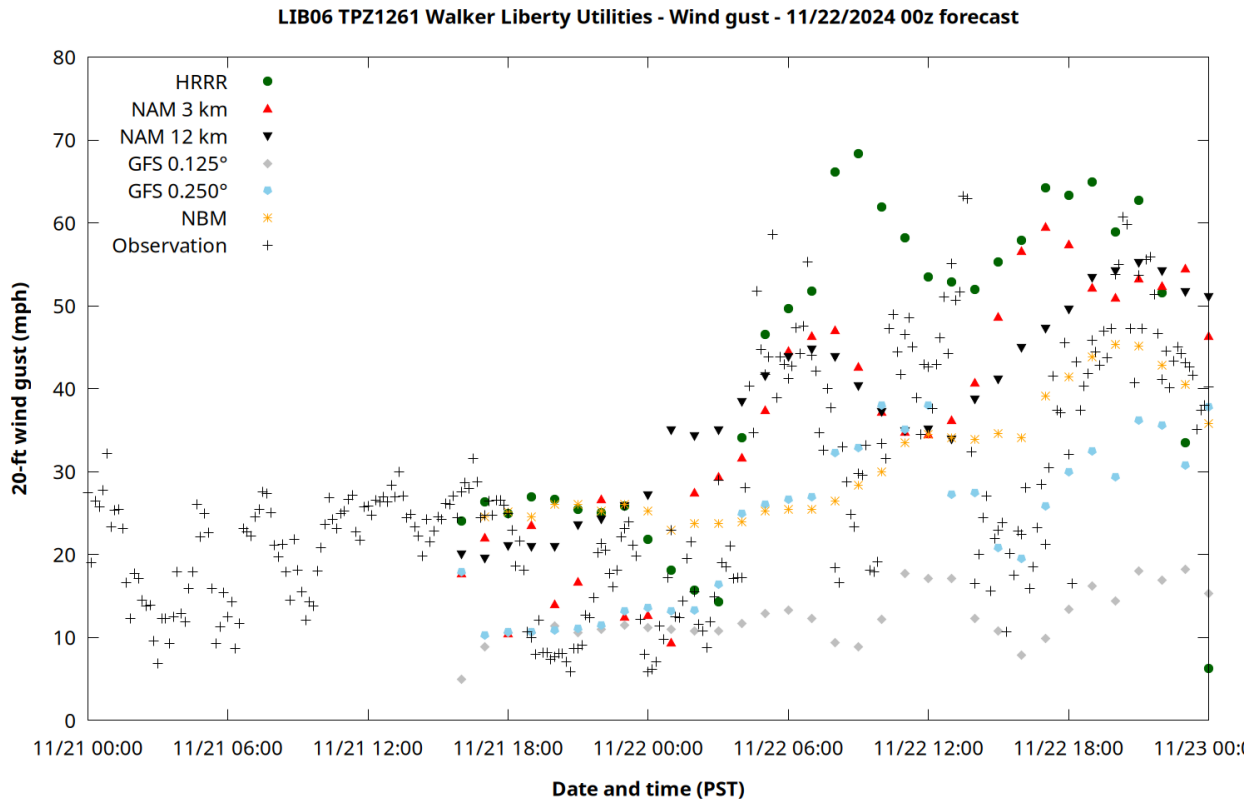



Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

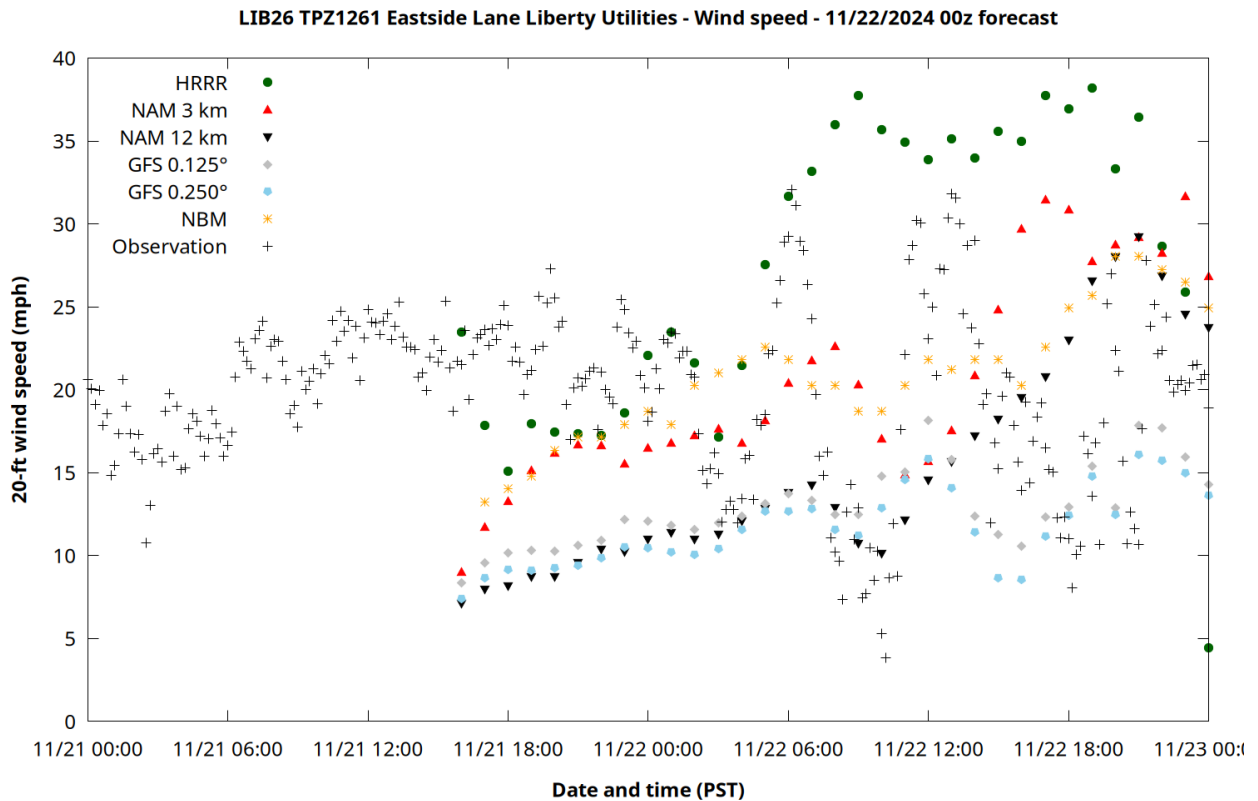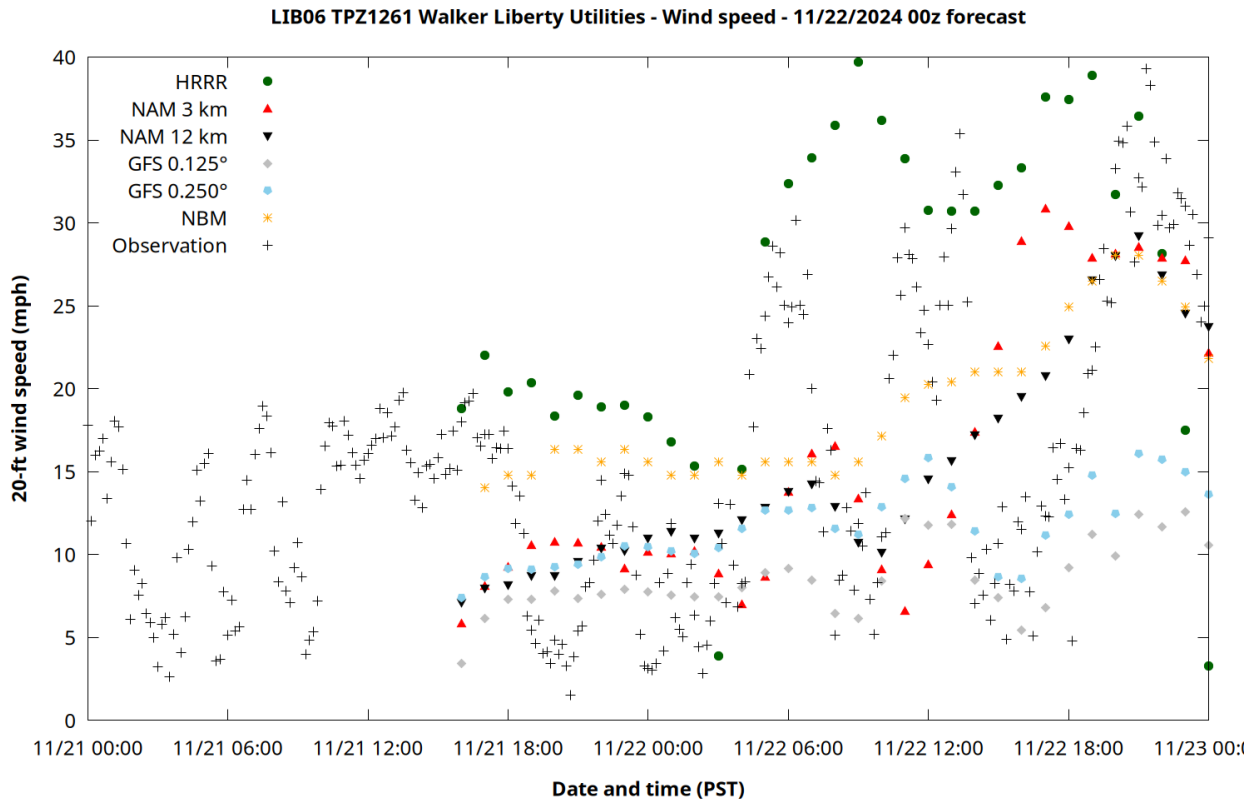

Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

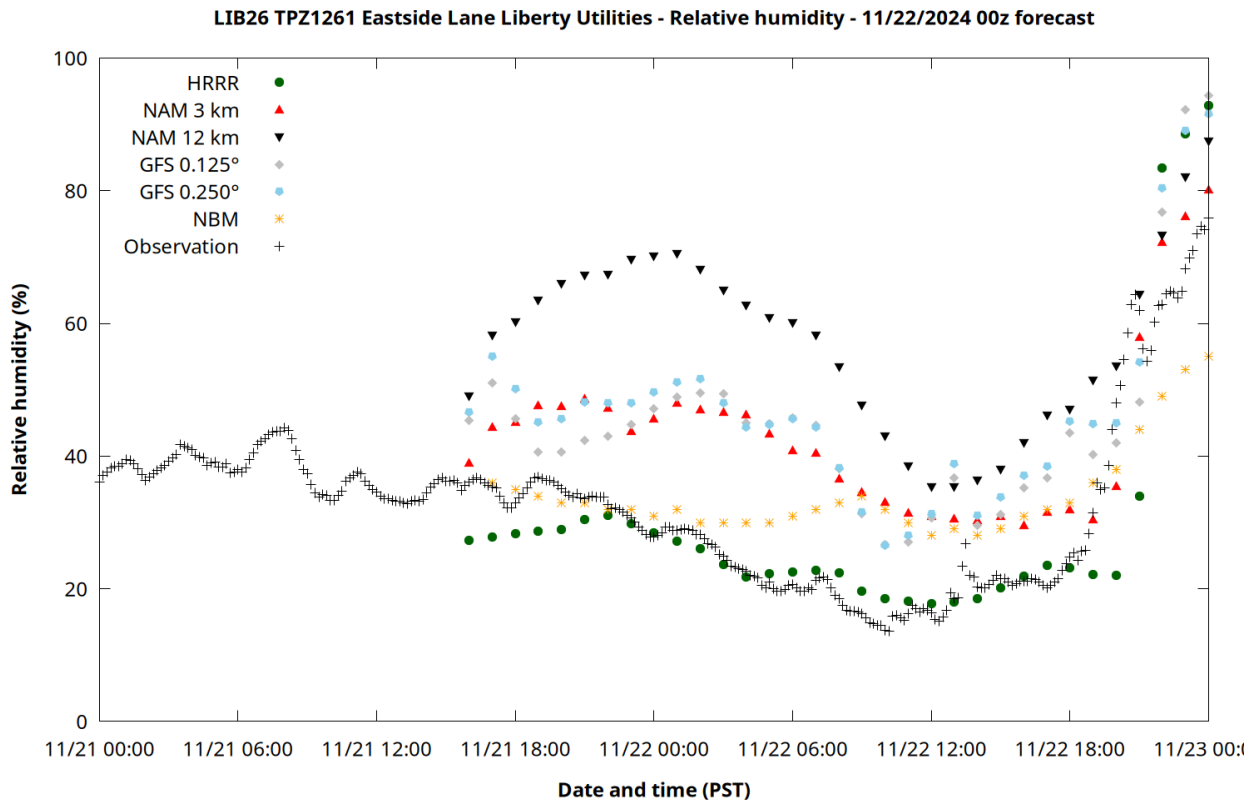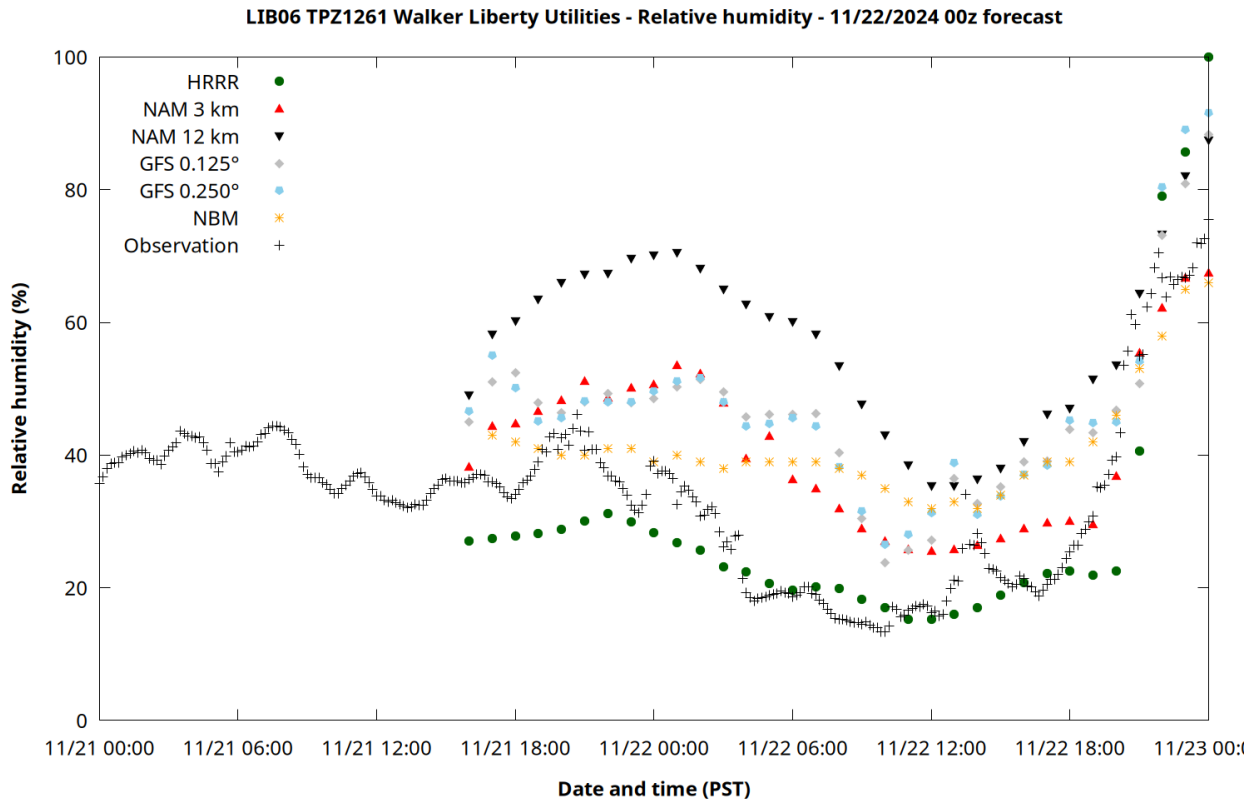

Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

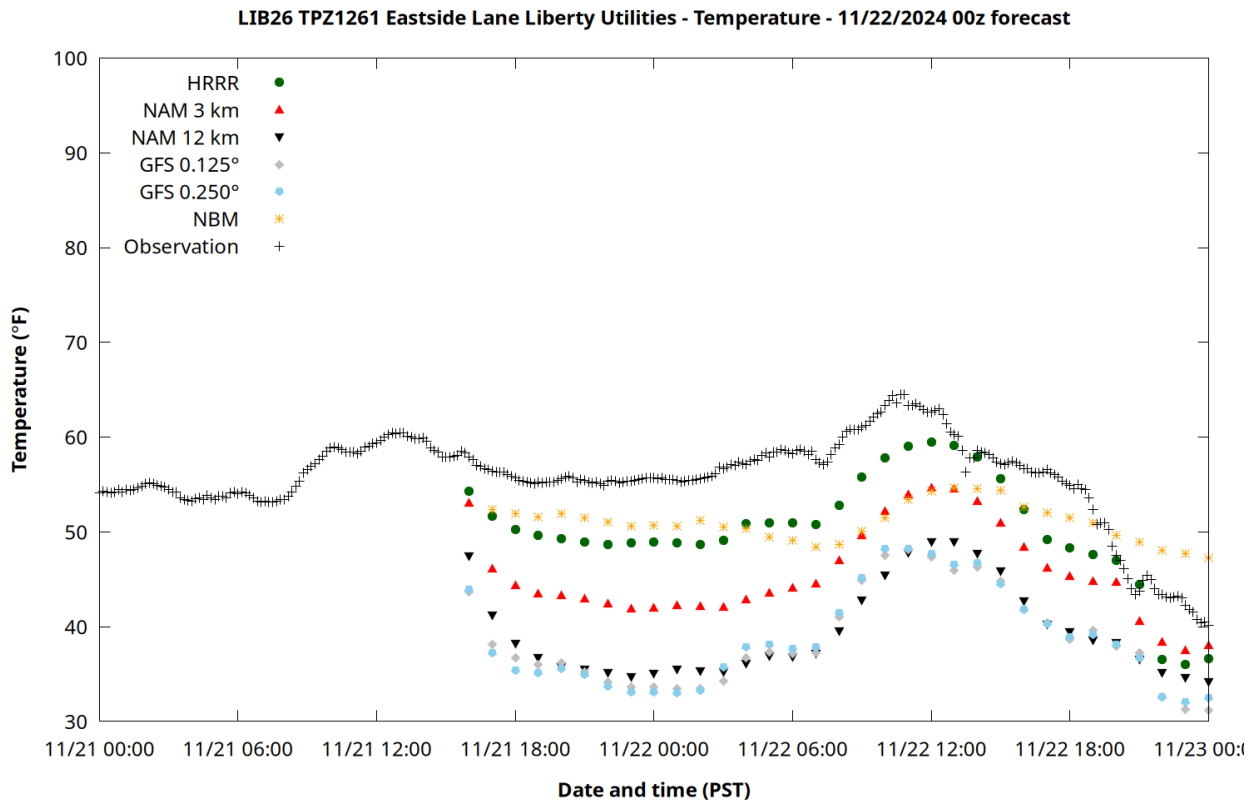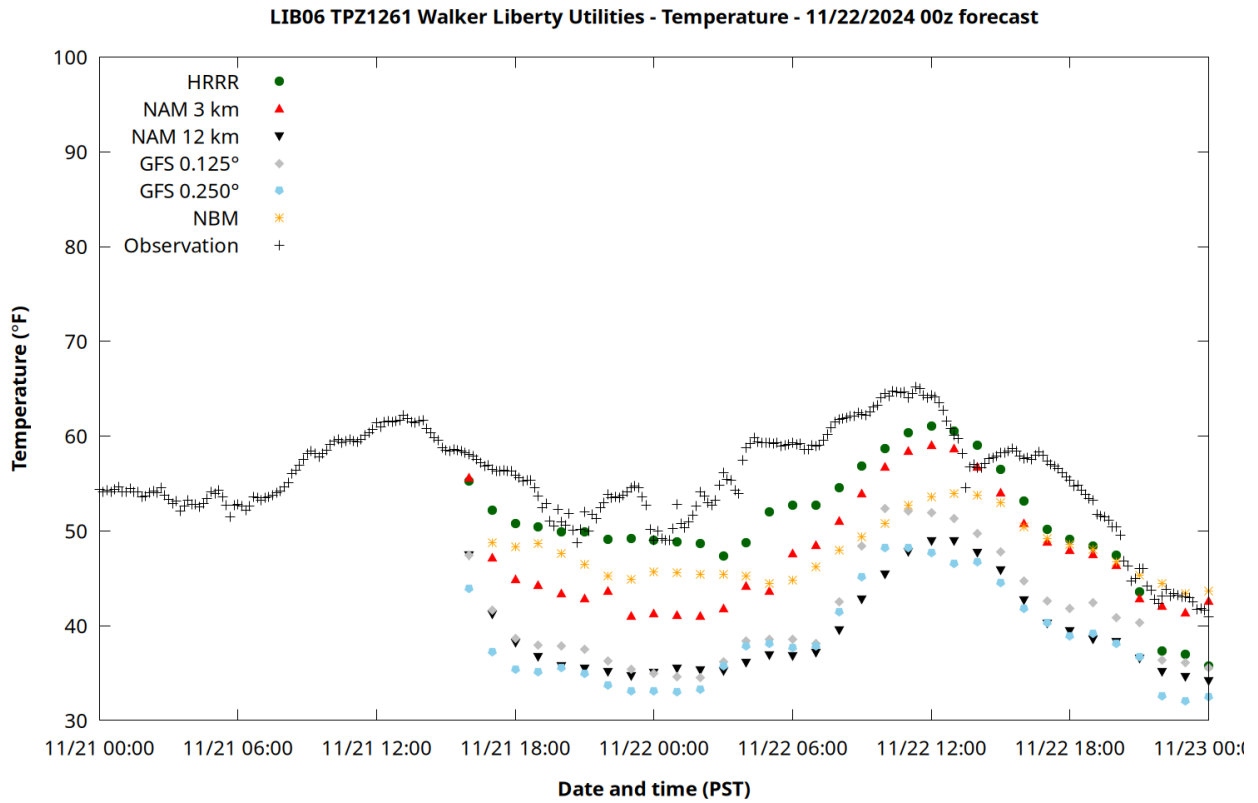

2.3 A thorough and detailed description of the quantitative and qualitative factors Liberty considered in calling, sustaining, or curtailing each de-energization event including any fire risk or PSPS risk modeling results, and a specification of the factors that led to the conclusion of the de-energization event.

The quantitative factors that were considered include forecast vs. actual weather conditions and field observations, as discussed above. The de-energization event was concluded when observed wind gusts dropped below 40 mph, and relative humidity rose above 60%. Field observations considered in the decision also included lack of blowing debris and onset of precipitation.

2.4 An explanation of how the utility determined that the benefit of de-energization outweighed potential public safety risks, and analysis of the risks of de-energization against not de-energizing. The utility must identify and quantify customer, resident, and the general public risks and harms from de-energization and clearly explain risk models, risk assessment processes, and how the power disruptions to customers, residents, and the general public is weighed against the benefits of a proactive de-energization.

Liberty's goal is first and foremost, to protect the community, by promoting safety and minimizing risk to avoid unfavorable events. Sometimes, this is at the cost of temporary inconvenience or economic loss. Liberty understands the disruption that occurs to its customers when there is de-energization. As such, Liberty attempts to avoid a PSPS if possible and only when it is safe.

When weighing the decision to de-energize, Liberty works closely with its fire science consultant, CloudFire Inc. Other actions that Liberty takes include assessing the real-time wildfire risk model, Pyrecast, which indicated increased danger of a catastrophic wildfire if an ignition were to occur under the weather conditions forecasted. Pyrecast simulated the ignition of hundreds of millions of hypothetical fires across the landscape and models their spread under forecasted weather conditions. This makes it possible to identify areas where rapidly spreading fires may occur.

When considering PSPS, Liberty also considers the impact on vulnerable populations and critical infrastructure. In assessing public safety risk, consideration is given to mitigation strategies in place to assist individuals. Prior to implementing PSPS, Liberty stages resources and staffing at nearby Community Resource Centers to provide electricity to the public during the event. Liberty coordinates closely with public safety partners to help mitigate the impacts to public safety when implementing a PSPS.

Before de-energizing Liberty weighs the potential catastrophic consequences of not calling PSPS against the economic, logistical, and social costs of doing so.

2.5 Explanation of alternatives considered and evaluation of each alternative.

Liberty considered two potential alternates.

Sectionalization was considered as an alternative. There was no alternate source downstream of the Muller 1296 circuit to safely feed the remaining portion of the circuit that did not reside within the PSPS zone. As a result, the entire feed downstream of the Muller 1296 circuit was de-energized. For the Topaz 1202 circuit, Liberty was able to sectionalize the southernmost section of the circuit where ignition risk was highest while maintaining power to upstream customers. With the above-discussed mitigations in

place, Liberty was able to limit de-energization to 355 customers on the Topaz 1202 circuit instead of the total of 782 customers.

Liberty also considered the use of line operations personnel in the field as an alternative to de-energization to monitor conditions and respond to weather caused outages. As weather observations indicated increased likelihood of a utility caused ignition as well as high likelihood of rapid fire spread, it was determined that on-the-ground resources would not be adequate to respond to and suppress a fire.


3 Description of the Event

3.1 The summary of time, place, and duration of the event, broken down by phase if applicable.

As discussed in Section 1.1. above, this event encompassed Liberty’s Muller 1296 circuit in Alpine County and Liberty’s Topaz 1202 circuit in Mono County. On November 21, 2024, at 8:00 a.m., Liberty activated its EOC. On November 22, 2024, at approximately 8:00 a.m., Liberty de-energized approximately 709 customers in Alpine County. Subsequently, on November 22, 2024 at approximately 1:26 p.m., Liberty de-energized approximately 355 additional customers in Mono County. On November 22, 2024, at approximately 10:00 p.m., power was restored to the impacted areas and customers.

Figure 3-1 shows the location of Liberty’s November 22, 2024, PSPS event.

Figure 3-1: Map of De-energized Liberty Area, November 22, 2024, PSPS Event

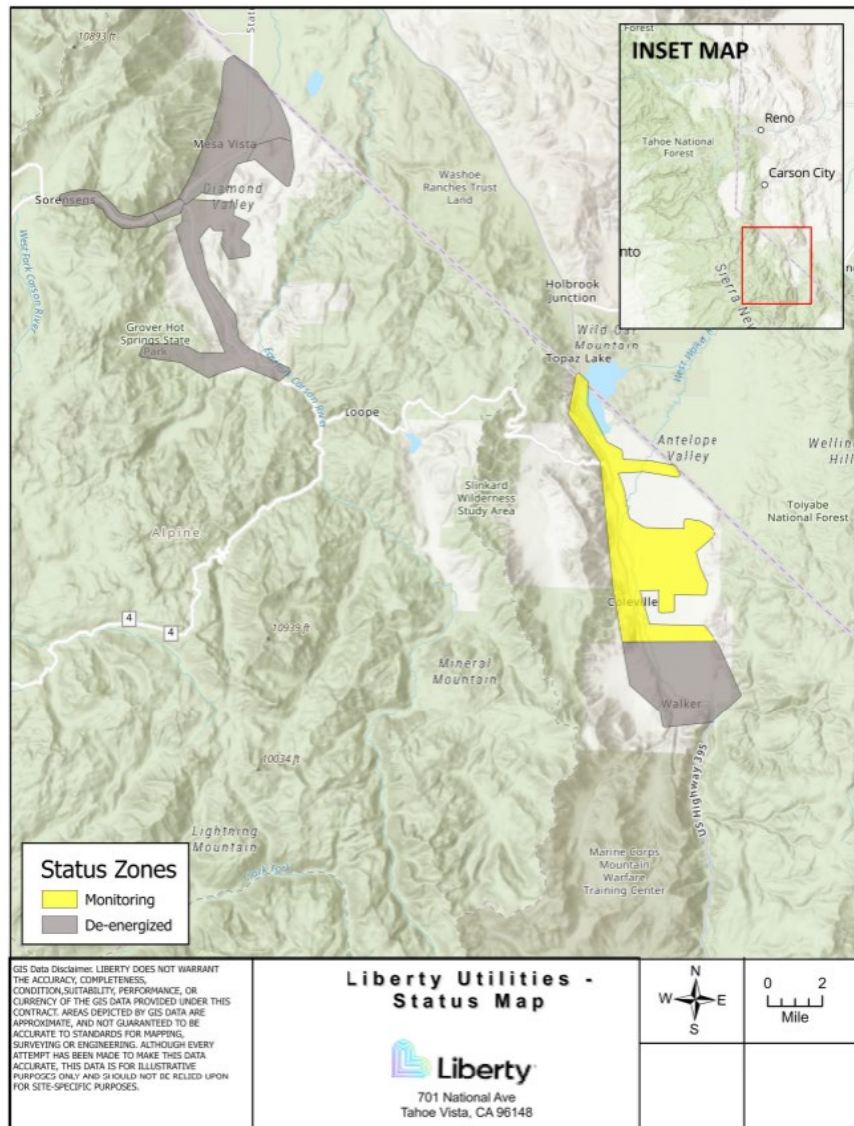

3.2 A zipped geodatabase file that includes PSPS event polygons of de-energized areas. The file should include items that are required in Section 3.3.

A zipped geodatabase file that includes all information in Section 3.3 is included with this filing.

3.3 A list of circuits de-energized, with the following information for each circuit. This information should be provided in both a PDF and excel spreadsheet.

The following table details the specified information for each circuit de-energized during this PSPS event and has also been included in the required PSPS Event Data Workbook filed with this report.

- County
- De-energization date/time
- Restoration date/time
- “All Clear” declaration date/time
- General Order (GO) 95, Rule 21.2-D Zone 1, Tier 2, or Tier 3 classification or non-High
- Fire Threat District
- Total customers de-energized
- Residential customers de-energized
- Commercial/Industrial customers de-energized
- Medical Baseline (MBL) customers de-energized
- AFN other than MBL customers de-energized
- Other Customers
- Distribution or transmission classification

Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

Table 3-1: Circuits De-Energized During November 22, 2024, PSPS Event

Circuits De-Energized									
County	Circuit Name	De-energization Date	De-energization Time (2400)	All Clear Declaration Date	All Clear Declaration Time (2400)	Restoration Date	Restoration Time (2400)	G.O. 95 Tier HFTD	Distribution/Transmission Classification
Alpine	Muller 1296	11/22/2024	7:59	11/22/2024	18:03	11/22/2024	19:56	2	Distribution
Mono	Topaz 1202 R2 and R3	11/22/2024	13:23	11/22/2024	20:39	11/22/2024	21:47	2	Distribution

Circuits De-Energized (continued)									
County	Circuit Name	Residential Customers De-energized	Commercial/Industrial customers De-energized	Medical Baseline customers De-energized	AFN other than MBL customers De-energized	Total customers De-energized	Restoration Time (2400)	G.O. 95 Tier HFTD	Other Customers
Alpine	Muller 1296	606	103	2	191	709	19:56	2	-
Mono	Topaz 1202 R2 and R3	307	48	10	133	355	21:47	2	-

4 Damage and Hazards to Overhead Facilities

4.1 Description of all found wind-related damages or hazards to the utility’s overhead facilities in the areas where power is shut off.

On November 22, 2024, Liberty identified a transformer on the Muller 1296 circuit had a broken hanger (115 Larson Canyon, Markleeville, CA). Liberty replaced the damaged transformer with a new 50 KVA transformer prior to re-energization.

4.2 A table showing circuit name and structure identifier (if applicable) for each damage or hazard, county that each damage or hazard is located in, whether the damage or hazard is in a High Fire Threat District (HFTD) or non-HFTD and the type of damage/hazard.

Table 4-1: Damage and Hazards Found During November 22, 2024, PSPS Event


Circuit Name	Structure Identifier	County	G.O. 95 Tier HFTD	Type of Damage/ Hazard
Muller 1296	214524	Alpine	2	Transformer with broken hanger

4.3 A zipped geodatabase file that includes the PSPS event damage and hazard points. The file should include fields that are in the table above.

A zipped geodatabase file that includes all information in Section 4.2 is included with this filing.

4.4 A PDF map identifying the location of each damage or hazard.

Figure 4-1: Map of Damage and Hazards Found During November 22, 2024, PSPS Event

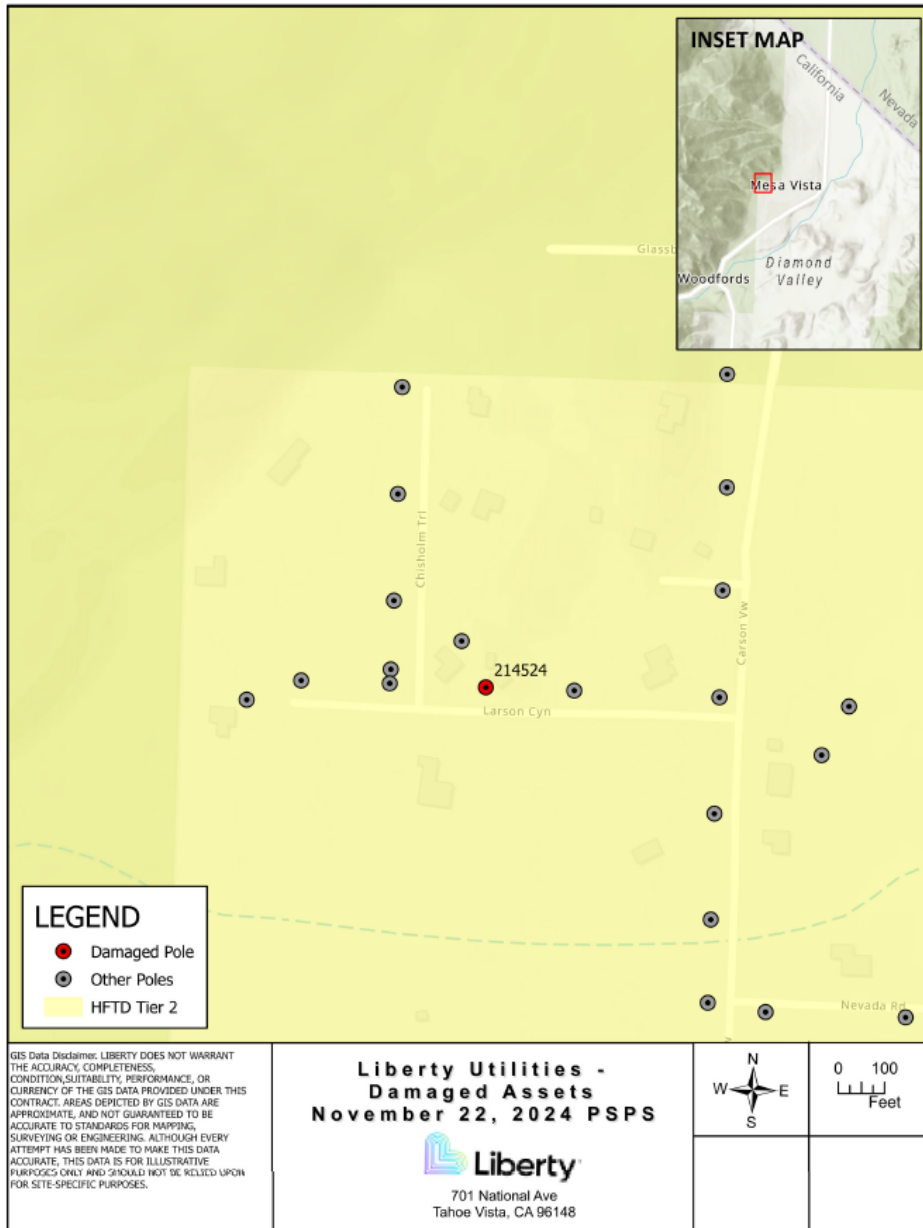

5 Notifications

5.1 A description of the notice to public safety partners, local/tribal governments, paratransit agencies that may serve all the known transit or paratransit dependent persons that may need access to a community resource center, multi-family building account holders/building managers in the AFN community, and all customers, including the means by which utilities provide notice to customers of the locations/hours/services available for CRCs, and where to access electricity during the hours the CRC is closed.

Table 5-1: Description of PSPS Notifications

Type of Notification	Recipients	Description
Initial Notice for PSPS Event	PSPs and CFI (includes local and Tribal governments, hospitals, water/wastewater, telecommunications and transportation providers, CBOs)	Initial notification of potential PSPS event when circuits are first identified for potential de-energization.
	All customers	
Updated Notice for PSPS Event	PSPs and CFI (includes local and Tribal governments, hospitals, water/wastewater, telecommunications and transportation providers, CBOs)	Updated notification of potential PSPS event when circuits are first identified for potential de-energization.
	All customers	
Imminent De-energize (expected)	PSPs and CFI (includes local and Tribal governments, hospitals, water/wastewater, telecommunications and transportation providers, CBOs)	Power shutoff expected soon (1-4 hours before potential de-energization).
	All customers	
De-energized (shutoff)	PSPs and CFI (includes local and Tribal governments, hospitals, water/wastewater, telecommunications and transportation providers, CBOs)	Power has been shut off (when de-energization is initiated)
	All customers	
Imminent Re-energize (prepare to restore)	PSPs and CFI (includes local and Tribal governments, hospitals, water/wastewater, telecommunications and transportation providers, CBOs)	Inspection/patrols of de-energized circuits for PSPS restoration has begun and power will be restored by estimated time.
	All customers	
Event concluded	PSPs and CFI (includes local and Tribal governments, hospitals, water/wastewater, telecommunications and transportation providers, CBOs)	Power has been restored and PSPS protocols are no longer enacted for this event.
	All customers	

See Appendix A for notifications to customers. Notifications to customers advised customers of CRC information. The notices and ongoing communications with customers directed customers to the [Liberty PSPS webpage](#) for real-time information related to CRCs. As part of Liberty’s PSPS notification process, all account holders including multi-family building account holders, received notices prior to de-energization.

See Appendix B for notifications to Public Safety Partners.

Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

See Appendix C for notifications to the CPUC.

5.2 Notification timeline including prior to de-energization, initiation, restoration, and cancellation, if applicable. The timeline should include the required minimum timeline and approximate time notifications were sent.

Table 5-2: Notification Timeline for Liberty November 22, 2024, PSPS Event

Event Order	Notification Type	Requirement Timeline	Notifications Sent To	Date Sent	Approximate Time Sent: Alpine County	Approximate Time Sent: Mono County
Pre-De-energization (prior)	Initial Notice for PSPS Event	72-48 hours	N/A	N/A	N/A	N/A
	Initial Notice for PSPS Event	48-24 hours	N/A	N/A	N/A	N/A
	Initial Notice for PSPS Event	12 hours prior	PSP, including CFI PSP	11/21/2024	9:54	9:56
		12 hours prior	MBL customers	11/21/2024	10:15	10:15
		12 hours prior	All other affected customers	11/21/2024	10:15	10:15
		12 hours prior	CalOES	11/21/2024	9:35	9:35
		12 hours prior	CPUC	11/21/2024	9:18	9:18
		12 hours prior				
	Updated Notice for PSPS Event	12 hours prior	PSP, including CFI PSP	11/21/2024	15:14	15:14
		12 hours prior	MBL customers	11/21/2024	15:02	15:02
		12 hours prior	All other affected customers	11/21/2024	15:02	15:02
		12 hours prior	CalOES	11/21/2024	15:00	15:00
		12 hours prior	CPUC	11/21/2024	15:28	15:28
		12 hours prior				
	Imminent De-energize (expected)	4-1 hours	PSP, including CFI PSP	11/22/2024	7:43	7:44
		4-1 hours	MBL customers	11/22/2024	7:30	7:30
		4-1 hours	All other affected customers	11/22/2024	7:30	7:30
		4-1 hours	CalOES	11/22/2024	7:10	7:10
4-1 hours		CPUC	N/A	N/A	N/A	
4-1 hours						
In-Event (during)	De-energized (shutoff)	De-energization	PSP, including CFI PSP	11/22/2024	7:59	13:46
		De-energization	MBL customers	11/22/2024	8:06	13:39
		De-energization	All other affected customers	11/22/2024	8:06	13:39

Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

Event Order	Notification Type	Requirement Timeline	Notifications Sent To	Date Sent	Approximate Time Sent: Alpine County	Approximate Time Sent: Mono County
		De-energization	CalOES	11/22/2024	8:02	15:35 ¹
		De-energization	CPUC	11/22/2024	8:06	15:26 ²
Restoration (after)	Imminent Re-energize (prepare to restore)	Imminent re-energization	PSP, including CFI PSP	11/22/2024	18:42	20:55
		Imminent re-energization	MBL customers	11/22/2024	18:53	21:01
		Imminent re-energization	All other affected customers	11/22/2024	18:53	21:01
		Imminent re-energization	CalOES	11/22/2024	19:53	19:53
		Imminent re-energization	CPUC	11/22/2024	22:55	22:55
	Event concluded	All clear	PSP and CFI	11/22/2024	20:14	21:53
		All clear	MBL customers	11/22/2024	22:24	21:59
		All clear	All other affected customers	11/22/2024	22:24	21:59
		All clear	CalOES	11/22/2024	22:03	22:03
		All clear	CPUC	11/22/2024	22:55	22:55

¹ Liberty momentarily shut off power to the Topaz circuit at 8:00 a.m. on November 22, 2024. This was captured in Liberty’s 8:01 a.m. notification to Cal OES, however the shutoff was unrelated to PSPS.

² Liberty momentarily shut off power to the Topaz circuit at 8:00 a.m. on November 22, 2024. This was captured in Liberty’s 8:06 a.m. and 9:16 a.m. notifications to the CPUC, however the shutoff was unrelated to PSPS.

5.3 For those customers where positive or affirmative notification was attempted, use the following template to report the accounting of the customers (which tariff and/or access and functional needs population designation), the number of notification attempts made, the timing of attempts, who made the notification attempt (utility or public safety partner) and the number of customers for whom positive notification was achieved. “Notification attempts made” and “Successful positive notification” must include the unique number of customer counts. When the actual notification attempts made is less than the number of customers that need positive notifications, the utilities must explain the reason. In addition, the utilities must explain the reason of any unsuccessful positive notifications.

Table 5-3: Positive Notifications to MBL Customers

Category	Total Number of Customers	Timing of Attempts	Notification Attempts	Successful Positive Notification	Who Made the Notification
Medical Baseline	13	Concurrent with notifications	Up to 3 notifications for each location	13	Liberty
Medical Baseline (deceased)	2	Concurrent with notifications	Up to 3 notifications for each location	-	Liberty

5.4 A copy or scripts of all notifications with a list of all languages that each type of notification was provided in, the timing of notifications, the methods of notifications and who made the notifications (the utility or local public safety partners).

Copies of all notifications are contained in Appendices A, B, and C. Liberty performed all primary customer notifications and encouraged public safety partners to amplify PSPS messages on their platforms as appropriate. Liberty offered all notifications in English and Spanish and provides links to PSPS materials in Spanish, French, German, Chinese, Vietnamese and Tagalog.

5.5 If the utility fails to provide notifications according to the minimum timelines set forth in D.19-05-042 and D.21-06-034, using the following template to report a breakdown of the notification failure and an explanation of what caused the failure.

Throughout the PSPS event, Liberty made significant effort to notify PSPs, local/tribal governments, critical facilities and infrastructure, and customers in accordance with the minimum timelines set forth by the CPUC in PSPS Phase 1 Guidelines (D.19-05-042), weather and other factors permitting. Given the rapidly changing weather conditions (as discussed in Section 2 of this report), Liberty prudently

activated its EOC within 24 hours of the forecasted PSPS event and notified PSPs and impacted customers as soon as practical. Liberty is not aware of any notification failures during the event.

5.6 Explain how the utility will correct the notification failures.

Not applicable; Liberty is not aware of any notification failures during this event.

5.7 Enumerate and explain the cause of any false communications citing the sources of changing data.

Not applicable; Liberty is not aware of any false communications during this event.

6 Local and State Public Safety Partner Engagement

6.1 List the organization names of public safety partners including, but not limited to, local governments, tribal representatives, first responders and emergency management, and critical facilities and infrastructure the utility contacted prior to de-energization, the date and time on which they were contacted, and whether the areas affected by the de-energization are classified as Zone 1, Tier 2, or Tier 3 as per the definition in CPUC General Order 95, Rule 21.2-D.

Table 6-1: Local and State Public Safety Partner Engagement

Entity Name	PSP Type	Organization	Title	HFTD Tier	Date Contacted	Time Contacted
Alpine County Government	Municipal	Alpine Co	Public Health Program Manager	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Alpine County Government	Municipal	Alpine Co	Public Health Program Manager	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Alpine County Government	Municipal	Alpine Co	Alpine Co Fire Chief	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Alpine Co	Law Enforcement	Alpine Co	Alpine Co Sheriff	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Alpine County Government	Municipal	Alpine Co.	Personnel and Risk Analyst	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Alpine County Government	Municipal	Alpine Co.	Undersheriff	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Alpine County Government	Municipal	Alpine Co.	HHS Dir	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Alpine County Government	Municipal	Alpine Co.	Pub Health Officer	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Alpine County Government	Municipal	Alpine Co.	Emergency Prep	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Alpine County Government	Municipal	Alpine Co.	Dir. Finance	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Alpine Co Fire	Fire Department	Alpine Co. Fire	Chief	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Alpine County Government	County	Alpine County	Deputy Dir Community Development	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.

Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

Entity Name	PSP Type	Organization	Title	HFTD Tier	Date Contacted	Time Contacted
Alpine County Government	County	Alpine County	County Supervisor	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Alpine County USD	School	Alpine County Office of Education	Superintendent of Schools	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Walker	Municipal	Community Emergency Response Team (CERT)		Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Eastern Sierra USD	School	Eastern Sierra Unified School District	Superintendent of Schools	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Eastern Sierra USD	School	Eastern Sierra Unified School District	Director of Facilities	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Mono County Government	Municipal	Mono Co.	IT Director	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Mono County Government	Municipal	Mono Co.	Emergency Manager	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Mono County Government	Municipal	Mono Co.	Director	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Mono County Government	Municipal	Mono Co.	Shelter Coordinator	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Mono County Government	Municipal	Mono Co.	Shelter Coordinator	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Mono County Government	County	Mono Co.	Shelter Coordinator Lead	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Mono County Government	Municipal	Mono Co.	Emergency Preparedness Manager	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Mono County Government	County	Mono Co.	Fiscal Specialist	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Mono County Government	County	Mono Co.	Fire Chief	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Mono County Government	County	Mono Co.	Sheriff Lieutenant	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Mono County Government	County	Mono Co.	Assistant Fire Chief	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.

Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

Entity Name	PSP Type	Organization	Title	HFTD Tier	Date Contacted	Time Contacted
Mono County Government	Municipal	Mono Co.	Administrative Officer	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Mono County Government	County	Mono Co.	County Supervisor	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Mono County Government	Municipal	Mono Co.	EMS Chief	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Mono County Government	County	Mono Co.	Assistant Fire Chief	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Mono County Government	County	Mono Co.	Sheriff	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Mono County Government	County	Mono County	PIO	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
USMC Mountain Warfare Training Center	Federal	USMC	MCMWTC	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Washoe Tribe	Tribal	Washoe Tribe		Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Washoe Tribe	Tribal	Washoe Tribe	Tribal Emergency Manager	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Washoe Tribe	Tribal	Washoe Tribe	Tribal Planning Director	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Washoe Tribe	Tribal	Washoe Tribe	Washoe Tribe Emergency Manager	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Washoe Tribe	Tribal	Washoe Tribe		Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.
Hung A Lel Ti Community	Tribal	Washoe Tribe	Hung A Lel Ti Community Chairman	Tier 2	11/21/2024, 11/22/2024	All stages of PSPS. Refer to table 5-2.

6.2 List the names of all entities invited to the utility’s Emergency Operations Center for a PSPS event, the method used to make this invitation, and whether a different form of communication was preferred by any entity invited to the utility’s emergency operation center.

Liberty did not invite external entities to its EOC meeting. Instead, Liberty conducted daily outreach with State and local public safety partners, as well as critical infrastructure entities, for the duration of this PSPS event to provide critical incident updates and a forum for resolving issues. See Table 6-1: Local and Public Safety Partner Engagement for the list of local public safety partners that received notifications related to this event.

Additionally, Liberty held the State Executive Briefing on November 22, 2024, at 4:00 p.m.

6.3 A statement verifying the availability to public safety partners of accurate and timely geospatial information, and real time updates to the GIS shapefiles in preparation for an imminent PSPS event and during a PSPS event.

After the EOC was activated, Liberty provided geospatial information and near real-time updates to public safety partners before and during the PSPS event through its Public Safety Partner Portal.

6.4 A description and evaluation of engagement with local and state public safety partners in providing advanced outreach and notification during the PSPS event.

Liberty submitted the CalOES Notification form via the State Dashboard beginning on November 21, 2024, at 9:35 a.m. Liberty conducted daily outreach with State and local public safety partners, as well as critical infrastructure entities, for the duration of this PSPS event to provide critical incident updates and a forum for resolving issues. See Table 6-1: Local and Public Safety Partner Engagement for the list of local public safety partners that received notifications related to this event.

6.5 Specific engagement with local communities regarding the notification and support provided to the AFN community.

Liberty worked with local public safety partners throughout the PSPS event to support AFN customers. See Table 6-1: Local and Public Safety Partner Engagement for the list of local public safety partners that received notifications related to this event. The public safety partners that provide support to the AFN community included Alpine County Health and Human Services and the Washoe Tribe. Liberty has a Memorandum of Understanding with the Washoe Tribe and has established a CRC location within close proximity to an AFN community in order to provide support. Additionally, Liberty understands that its Alpine County contacts support communications with vulnerable households, transportation arrangements if necessary, and collaboration with local sheriff’s departments. In Mono County, Liberty maintained communication with local public safety partners and Mono Health and Human Services.

6.6 Provide the following information on backup power (including mobile backup power) with the name and email address of a utility contact for customers for each of the following topics:

- a) Description of the backup generators available for critical facility and infrastructure customers before and during the PSPS.

There were no generator deployment requests for this activation.

- b) The capacity and estimated maximum duration of operation of the backup generators available for critical facility and infrastructure customers before and during the PSPS.

There were no generator deployment requests for this activation.

- c) The total number of backup generators provided to critical facility and infrastructure customer's site immediately before and during the PSPS.

None. There were no backup generator deployment requests for this activation.

- d) How the utility deployed this backup generation to the critical facility and infrastructure customer's site.

N/A.

- e) An explanation of how the utility prioritized how to distribute available backup generation.

N/A.

- f) Identify the critical facility and infrastructure customers that received backup generation.

N/A.

Any questions related to the information under this item may be directed to Lee Kiolbasa at the following email address: Leonard.Kiolbasa@libertyutilities.com.

7 Complaints and Claims

7.1 The number and nature of complaints received as the result of the de-energization event and claims that are filed against the utility because of de-energization. The utility must completely report all the informal and formal complaints, meaning any expression of grief, pain, or dissatisfaction, from various sources, filed either with CPUC or received by the utility as a result of the PSPS event.

As of November 21, 2024, Liberty has received 16 informal complaints and one formal customer claim related to this PSPS event.³ If any additional complaints or claims related to this PSPS event are received after the filing of date of this report in its annual post-season report, Liberty will provide an update.

Table 7-1: Count and Nature of Complaints Received⁴

Nature of Complaints	Complaint Format	Number of Complaints
Public safety partners checked in on CRC and expressed interest in a follow-up meeting to discuss planning for PSPS events.	In person	2
Didn't understand the need for the PSPS.	In person/Phone calls	12
Concern about lack of advance warning.	Phone call	1
Concern about the well-being of pets.	In person	1

Table 7-2: Count and Type of Claims Received

Type of Claim	Number of Claims
Loss of income from PSPS event	1

³ The complaints received for Liberty's Post Event Report for its November 22, 2024 PSPS event is identical to the complaints received for Liberty's Post-Event Report for its November 20, 2024 PSPS event because all complaints for both events were tracked in one tracker.

⁴ Table 7-1 in Liberty's Post Event Report for its November 22, 2024 PSPS event is identical to Table 7-1 in Liberty's Post-Event Report for its November 20, 2024 PSPS event because all complaints for both events were tracked in one tracker.

8 Power Restoration

8.1 A detailed explanation of the steps the utility took to restore power.

Liberty began the re-energization process after extreme weather conditions subsided (based on input from Weather Services), there was no further threat of fire weather conditions forecasted for the areas of concern (based on input from same), after patrol was conducted and the Incident Commander approved restoration operations. All circuit restoration during this event was guided by safety considerations, including safety risks associated with patrolling certain circuits at night.

Please see Table 5-1 for details related to customer re-energizations, including restoration date, restoration time, and total customer count.

8.2 The timeline for power restoration, broken down by phase if applicable.

Liberty restored power to 709 impacted customers on the Muller 1296 circuit on November 22, 2024, at 7:56 p.m. Liberty restored power to 355 impacted customers on the Topaz 1202 circuit on November 22, 2024 at 9:47 p.m.

8.3 For any circuits that require more than 24 hours to restore, the utility shall explain why it was unable to restore each circuit within this timeframe, using the format below.

Not applicable. No circuits required more than 24 hours to restore.

9 Community Resource Centers

9.1 Report information including the address of each location during a de-energization event, the location (in a building, a trailer, etc.), the assistance available at each location, the days, and hours that it was open, and attendance (i.e., number of visitors).

Table 9-1: Community Resource Centers

Address	Location Type	Describe the Assistance Available	Hours of Operations (Date/Time)	Number of visitors
96 Washoe Blvd, Markleeville, CA 96120	CRC	Small portable device charging (such as cell phone, laptop, and small medical devices), Wi-Fi, chairs, seasonal cooling, and heating, PSPS information, snacks, water, ice, ADA compliant restrooms.	11/22/2024, 8a.m.-10p.m.	32
442 Mule Deer Drive, Walker, CA 93517	CRC	Small portable device charging (such as cell phone, laptop, and small medical devices), Wi-Fi, chairs, seasonal cooling, and heating, PSPS information, snacks, water, ice, ADA compliant restrooms.	11/22/2024, 8a.m.-10p.m.	5

9.2 Any deviations and explanations from the CRC requirement including operation hours, ADA accessibility, and equipment.

Liberty is not aware of any deviations from CRC requirements during this event.

9.3 A map identifying the location of each CRC and the de-energized areas.

Figure 9-1: Community Resource Centers (Washoe)



Figure 9-2: Community Resource Centers (Walker)



10 Mitigations to Reduce Impact to Customers

10.1 Mitigation actions and impacts including: sectionalization devices, temporary generation, microgrids, permanent backup generation, transmission switching, covered conductor, and any other grid hardening that mitigated the impact of the event.

For the Topaz 1202 circuit, Liberty was able to sectionalize the southernmost section of the circuit, where ignition risk was highest, while maintaining power to upstream customers. With the above-discussed mitigations in place, Liberty was able to limit de-energization to 355 customers on the Topaz 1202 circuit instead of the total of 782 customers. In addition, Liberty utilized sectionalizing devices to patrol and re-energize the Muller 1296 circuit in three phases.

11 Lessons Learned from this Event

11.1 Threshold analysis and the results of the utility’s examination of whether its thresholds are adequate and correctly applied in the de-energized areas.

Liberty believes its CRI thresholds on the Muller 1296 and Topaz 1202 circuits are adequate and were correctly applied. In a continued effort to constantly improve public safety, Liberty intends to conduct an evaluation of its thresholds in advance of the 2025 fire season.

11.2 Any lessons learned that will lead to future improvement for the utility.

Table 11-11: Lessons Learned

Issue	Discussion	Resolution
Customer complaint tracker	All customer complaints regarding Liberty’s 11/20 and 11/22 PSPS events were captured on the same tracker, without date stamps to differentiate.	Utilize a separate customer complaint tracker for each PSPS event.
Customer counts for CalOES and CPUC notifications	Extracting customer counts and breakdowns for each circuit or circuit segment during the event can cause delays in notifications.	Liberty will assess whether it can create pre-populated spreadsheets with customer count by circuit segment in advance of the 2025 PSPS season.
Deceased MBL customers	Liberty became aware of two deceased MBL customers during the event.	Liberty will continue to update its MBL customer information and conduct outreach pre-PSPS season.
Customer confusion regarding fire weather conditions.	Liberty received questions from customers regarding rationale for PSPS.	Liberty distributed informational materials and videos regarding PSPS to its PSPS.
Tracking communications for post-event reporting.	Some items on Liberty’s internal communications tracker require additional follow-up post event to clarify details.	Sort internal communications tracker to facilitate efficient post-event reporting.


12 Other Relevant Information

Liberty does not have any other relevant information to share at this time.

13 Officer Verification

I am an officer of the applicant corporation herein and am authorized to make this verification on its behalf. I am informed and believe that the matters stated in this foregoing document are true.

I declare under penalty of perjury that the foregoing is true and correct. Executed on this 10th of December, 2024 in Downey, California.

A handwritten signature in black ink that reads "Edward Jackson". The signature is written in a cursive style with a horizontal line underneath it.

Edward Jackson
President, California

14 Appendix A – Customer Notifications

POTENTIAL TO DE-ENERGIZE / MONITORING NOTIFICATIONS

Thursday, November 21 Customer Communications (Morning)

The following message was distributed via OnSolve to potentially impacted customers on Thursday, November 21 at 10:15 AM:

Email:

This is an important alert from your electric provider, Liberty. Due to extreme weather conditions that increase the risk of a potential wildfire, a Public Safety Power Shutoff (PSPS) may be implemented for your area on or about Friday, November 22 at 5:00 a.m. The power shutoff may last more than 24 hours. Customers are encouraged to visit one of our two Community Resource Centers on Friday, November 22 from 8 a.m. -10 p.m. if they are unable to secure necessary alternative power. (1) The Woodfords Community Center, 96 Washoe Blvd. Markleeville, CA or (2) The Walker Community Center 442 Mule Deer Drive, Walker, CA.

Details of the PSPS can be found on our website and will be updated as necessary.

<https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

For additional updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA).

Phone/Text:

1. This is an important alert from your electric provider, Liberty. Due to extreme weather conditions that increase the risk of a potential wildfire, a Public Safety Power Shutoff (PSPS) may be implemented for your area on or about Friday, November 22 at 5:00 a.m. The power shutoff could last more than 24 hours.

2. Customers are encouraged to visit one of our two Community Resource Centers on Friday, November 22 from 8 a.m. -10 p.m. if they are unable to secure necessary alternative power. (1) The Woodfords Community Center, 96 Washoe Blvd. Markleeville, CA or (2) The Walker Community Center 442 Mule Deer Drive, Walker, CA. Details of the PSPS can be found on our website.

The following message was distributed via email to all customers on Thursday, November 21 at 10:09 AM:

ATTENTION Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker Customers

Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

Due to extreme weather conditions that increase the risk of a potential wildfire, a Public Safety Power Shutoff (PSPS) may be implemented for [THESE AREAS](#) (Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker customers) on or about Friday, November 22, 2024, at about 5 a.m., and may last more than 24 hours. Customers are encouraged to visit our Community Resource Centers from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, if they are unable to secure necessary alternative power.

A Public Safety Power Shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where conditions present an increased wildfire risk. The practice of de-energization is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

How to Prepare for a PSPS

Below are resources in multiple languages to help you understand, prepare for, and endure a PSPS event. [Here is the website with PSPS information in multiple languages.](#)

Debido a las condiciones climáticas extremas, se puede implementar un corte de energía de seguridad pública (PSPS) para [ESTAS ÁREAS](#) (Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker customers) en o alrededor del viernes 22 de noviembre de 2024, aproximadamente a las 5 a.m., pero podría durar más de 24 horas. Se anima a los clientes a visitar nuestro Centros de recursos comunitarios de 8 a.m. a 10 p.m. en el 96 Washoe Blvd, Markleeville, CA, o en el Walker Community Center, 442 Mule Deer Drive, Walker, CA, si no pueden conseguir la energía alternativa necesaria.

Un corte de energía de seguridad pública (PSPS) es un procedimiento de seguridad utilizado por las empresas eléctricas para apagar proactivamente la energía cuando y donde las condiciones presentan un mayor riesgo de incendios forestales. La práctica de la desenergización es apoyada por la Comisión de Servicios Públicos de California (CPUC) como una mejor práctica de seguridad.

Cómo prepararse para un PSPS

A continuación se presentan recursos en varios idiomas para ayudarlo a comprender, prepararse y soportar un evento PSPS.

Resources in Other Languages

PSPS Fact Sheet

- [Español](#)
- [Français](#)
- [Deutsch](#)
- [中国人](#)
- [Tiếng Việt](#)
- [Tagalog](#)

PSPS Preparation

- [Español](#)
- [Français](#)
- [Deutsch](#)
- [中国人](#)
- [Tiếng Việt](#)
- [Tagalog](#)

The following messages were posted to Liberty's social media on Thursday, November 21 at 9:46 AM:

Social Media – All Customers

*Twitter Thread: *numbers identify position in the thread*

1. Liberty may implement a Public Safety Power Shutoff (PSPS) for **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker** customers due to extreme weather conditions that increase the risk of a potential wildfire. <attach map>
2. Customers are encouraged to plan ahead for the possibility of an extended power shutoff that may begin around 5:00 a.m. on Friday, November 22, and may last more than 24 hours.
3. Customers are encouraged to visit one of our two Community Resource Centers on Friday, November 22 from 8 a.m. -10 p.m. if they are unable to secure necessary alternative power. (1) The Woodfords Community Center, 96 Washoe Blvd., Markleeville, CA or (2) The Walker Community Center, 442 Mule Deer Drive, Walker, CA.
4. Further details can be found on our webpage: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Facebook Post:

Liberty may implement a Public Safety Power Shutoff (PSPS) for **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker** customers due to extreme weather conditions that increase the risk of a potential wildfire. Customers are encouraged to plan ahead for the possibility of an extended power shutoff that may begin around 5:00 a.m. on Friday, November 22, and may last more than 24 hours.

Customers are encouraged to visit one of our two Community Resource Centers on Friday, November 22 from 8 a.m. -10 p.m. if they are unable to secure necessary alternative power. (1) The Woodfords Community Center, 96 Washoe Blvd. Markleeville, CA or (2) The Walker Community Center 442 Mule Deer Drive, Walker, CA.

Further details can be found on our webpage: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

The following was added to Liberty’s website on Thursday, November 21 at 9:28 AM:

Public Safety Power Shutoff Update for Liberty Customers

Liberty may implement a Public Safety Power Shutoff (PSPS) for THESE AREAS (**Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker customers**) due to extreme weather conditions that increase the risk of a potential wildfire **on or about Friday, November 22, 2024, at about 5 a.m.** The power shutoff could last more than 24 hours.

Customers are encouraged to visit our Community Resource Centers from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, if they are unable to secure necessary alternative power.

Monitored Fire Weather Conditions		
Energy Release Component	Wind Gusts	Fosberg Fire Weather Index
<20% safety threshold: 92nd percentile	>60 mph safety threshold: 40 mph	>80 safety threshold: 50

What Do I Need to Know?

- Power is expected to be shut off on or about Friday, November 22, 2024, at about 5 a.m.
- Predicted weather conditions warrant a PSPS forecasted for the aforementioned areas, date, and time.
- Approximately 1,490 customers will be impacted.
- Public safety partners were contacted on Thursday, November 21 and made aware of medically sensitive customers who will be impacted by the PSPS.

Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

- Two Community Resource Centers (CRC) are being activated. The CRC will remain open during the event between the hours of 8 a.m. to 10 p.m. throughout the de-energization event to provide customers with resources.
- Customers who require power to operate life-essential medical equipment are strongly encouraged to visit our Community Resource Center from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA if they are unable to secure necessary alternative power.
- For additional information and real-time updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

View Areas Impacted by the PSPS [HERE](#)

When Will Power Be Restored?

Liberty will begin the process to restore power when weather conditions retreat below the aforementioned safety thresholds. The restoration process includes conducting safety inspections on power lines and electric infrastructure throughout the impacted communities, an essential action that must be completed prior to lifting the PSPS and restoring power. The power shutoff could last more than 24 hours. Thank you for your patience. We will provide additional updates as they become available.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If it is determined that the forecasted conditions meet or exceed safety thresholds, Liberty will initiate a PSPS.

Safety Thresholds:

- The Energy Release Component (measures dry fuel conditions) exceeds 92nd percentile
- Wind gusts exceed 40 miles per hour
- Fosberg Fire Weather Index (measures speed of potential fire) exceeds 50

In the event that a PSPS is a possibility, Liberty will attempt to contact customers through calls, texts, and emails using contact information on file. Customers should keep their contact information up-to-date and follow Liberty on Facebook and X to receive timely PSPS updates.

What Other Wildfire Mitigation Efforts Does Liberty Have in Place to Protect Our Community?

Catastrophic wildfires have become all too common in California. Due to the dense vegetation and dry brush that characterize much of our landscape, the Lake Tahoe Basin and surrounding forested areas have been designated either "High" or "Very High" Fire Hazard Severity Zones by CAL FIRE.

Liberty is taking steps to mitigate the risk of wildfires in the communities we serve. Outlined below are the key components of our Wildfire Mitigation Plan.

[View Mitigation Plan](#)

Infrastructure Hardening

Infrastructure hardening is an ongoing system infrastructure improvement and replacement process aimed at lowering the potential of fires sparked by electric infrastructure. Over the next several years, Liberty will conduct the following improvements to support this process:

- Install covered conductors
- Replace conventional fuses with limiting fuses
- Test and replace aging poles
- Underground sections of the grid
- Remove tree attachments (electrical infrastructure attached to trees)
- Decommission the old wood structure Brockway Substation and replace with a new modern substation
- Complete system audit (inspect 100% of all poles and infrastructure in the system)

Vegetation Management

Liberty crews are deployed year-round throughout the region to inspect trees and vegetation in the vicinity of power lines. In compliance with state law and safety best practices, Liberty will trim or remove trees or branches that have grown too close to power lines in order to mitigate wildfire risk.

When trees are identified for trimming, crews are instructed to prune branches and vegetation back to a minimum of 12 feet from the high voltage power lines to maintain adequate clearance over the maintenance cycle period. Crews will additionally identify trees for removal that are dead, diseased, or structurally unsound, despite being within the acceptable clearance zone, if they have the potential to fall on power lines.

Customers should never attempt to conduct the tree trimming activities themselves, due to the risk of coming into contact with power lines during the process.

Liberty offers complimentary tree-trimming services to customers who believe a tree or branch may be hazardous to nearby electric infrastructure. If you spot a tree or branch you feel may be a hazard, please call us at 530-546-1787.

Important

If we have your current contact information, Liberty will be sending outreach updates to affected customers. If we don't have your current contact information on file, please email it to us immediately at: CustomerInfo@libertyutilities.com.

Please help to keep our customer service phone lines clear for emergencies.

Thursday, November 21 Customer Communications (Afternoon)

The following message was distributed via OnSolve to potentially impacted customers on Thursday, November 21 at 3:02 PM:

Email:

This is an important alert from your electric provider, Liberty. Liberty continues to monitor extreme weather conditions that may increase the risk of a potential wildfire. Liberty may implement a Public Safety Power Shutoff (PSPS) for (Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker customers) on or about Friday, November 22, 2024, at about 5 a.m. The power shutoff could last more than 24 hours. If a PSPS is implemented, Liberty will notify customers.

In the event a PSPS is implemented, customers are encouraged to visit one of our two Community Resource Centers on Friday, November 22 from 8 a.m. -10 p.m. if they are unable to secure necessary alternative power. (1) The Woodfords Community Center, 96 Washoe Blvd. Markleeville, CA or (2) The Walker Community Center 442 Mule Deer Drive, Walker, CA.

Details of the PSPS can be found on our website and will be updated as necessary.

<https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

For additional updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA).

Phone/Text:

1. This is an important alert from your electric provider, Liberty. Liberty continues to monitor extreme weather conditions that increase the risk of a potential wildfire. Liberty may implement a Public Safety Power Shutoff (PSPS) for your area on or about Friday, November 22, 2024, at about 5 a.m. The power shutoff could last more than 24 hours. In the event that a PSPS is implemented, Liberty will notify customers.

2. Customers are encouraged to visit one of our two Community Resource Centers on Friday, November 22 from 8 a.m. -10 p.m. if they are unable to secure necessary alternative power. (1) The Woodfords

Community Center, 96 Washoe Blvd. Markleeville, CA or (2) The Walker Community Center 442 Mule Deer Drive, Walker, CA. Details of the PSPS can be found on our website.

The following messages were posted to Liberty's social media on Thursday, November 21 at 2:31 PM:

Social Media – All Customers

*Twitter Thread: *numbers identify position in the thread*

1. Liberty continues to monitor extreme weather conditions that increase the risk of a potential wildfire. Liberty may implement a Public Safety Power Shutoff (PSPS) for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker customers. <attach map>
2. Customers are encouraged to plan ahead for the possibility of an extended power shutoff that may begin around 5:00 a.m. on Friday, November 22, 2024, and may last more than 24 hours. In the event that a PSPS is implemented, Liberty will notify customers.
3. Customers are encouraged to visit one of our two Community Resource Centers on Friday, November 22 from 8 a.m. -10 p.m. if they are unable to secure necessary alternative power. (1) The Woodfords Community Center, 96 Washoe Blvd., Markleeville, CA or (2) The Walker Community Center, 442 Mule Deer Drive, Walker, CA.
4. Further details can be found on our webpage: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Facebook Post:

Liberty continues to monitor extreme weather conditions that increase the risk of a potential wildfire. Liberty may implement a Public Safety Power Shutoff (PSPS) for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker customers. Customers are encouraged to plan ahead for the possibility of an extended power shutoff that may begin around 5:00 a.m. on Friday, November 22, 2024 that may last more than 24 hours. If a PSPS is implemented, Liberty will notify customers.

Customers are encouraged to visit one of our two Community Resource Centers on Friday, November 22 from 8 a.m. -10 p.m. if they are unable to secure necessary alternative power. (1) The Woodfords Community Center, 96 Washoe Blvd. Markleeville, CA or (2) The Walker Community Center 442 Mule Deer Drive, Walker, CA.

Further details can be found on our webpage: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

The following was added to Liberty's website on Thursday, November 21 at 3:07 PM:

Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

Public Safety Power Shutoff Update for Liberty Customers

November 20, update:

Liberty continues to monitor extreme weather conditions that increase the risk of a potential wildfire. Liberty may implement a Public Safety Power Shutoff (PSPS) for [THESE AREAS](#) (Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker customers) on or about Friday, November 22, 2024, at about 5 a.m. The power shutoff could last more than 24 hours. In the event that a PSPS is implemented, Liberty will notify customers.

Customers are encouraged to visit our Community Resource Centers from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, if they are unable to secure necessary alternative power.

November 20, 9:20 a.m.:

Liberty may implement a Public Safety Power Shutoff (PSPS) for [THESE AREAS](#) (Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker customers) due to extreme weather conditions that increase the risk of a potential wildfire on or about Friday, November 22, 2024, at about 5 a.m. The power shutoff could last more than 24 hours.

Customers are encouraged to visit our Community Resource Centers from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, if they are unable to secure necessary alternative power.

Monitored Fire Weather Conditions		
Energy Release Component	Wind Gusts	Fosberg Fire Weather Index
<20% safety threshold: 92nd percentile	>60 mph safety threshold: 40 mph	>80 safety threshold: 50

What Do I Need to Know?

Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

- Power is expected to be shut off on or about Friday, November 22, 2024, at about 5 a.m.
- Predicted weather conditions warrant a PSPS forecasted for the aforementioned areas, date, and time.
- Approximately 1,490 customers will be impacted.
- Public safety partners were contacted on Thursday, November 21 and made aware of medically sensitive customers who will be impacted by the PSPS.
- Two Community Resource Centers (CRC) are being activated. The CRC will remain open during the event between the hours of 8 a.m. to 10 p.m. throughout the de-energization event to provide customers with resources.
- Customers who require power to operate life-essential medical equipment are strongly encouraged to visit our Community Resource Center from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA if they are unable to secure necessary alternative power.
- For additional information and real-time updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

View Areas Impacted by the PSPS [HERE](#)

When Will Power Be Restored?

Liberty will begin the process to restore power when weather conditions retreat below the aforementioned safety thresholds. The restoration process includes conducting safety inspections on power lines and electric infrastructure throughout the impacted communities, an essential action that must be completed prior to lifting the PSPS and restoring power. The power shutoff could last more than 24 hours. Thank you for your patience. We will provide additional updates as they become available.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If it is determined that the forecasted conditions meet or exceed safety thresholds, Liberty will initiate a PSPS.

Safety Thresholds:

- The Energy Release Component (measures dry fuel conditions) exceeds 92nd percentile
- Wind gusts exceed 40 miles per hour

Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

- Fosberg Fire Weather Index (measures speed of potential fire) exceeds 50

In the event that a PSPS is a possibility, Liberty will attempt to contact customers through calls, texts, and emails using contact information on file. Customers should keep their contact information up-to-date and follow Liberty on Facebook and X to receive timely PSPS updates.

What Other Wildfire Mitigation Efforts Does Liberty Have in Place to Protect Our Community?

Catastrophic wildfires have become all too common in California. Due to the dense vegetation and dry brush that characterize much of our landscape, the Lake Tahoe Basin and surrounding forested areas have been designated either "High" or "Very High" Fire Hazard Severity Zones by CAL FIRE.

Liberty is taking steps to mitigate the risk of wildfires in the communities we serve. Outlined below are the key components of our Wildfire Mitigation Plan.

[View Mitigation Plan](#)

Infrastructure Hardening

Infrastructure hardening is an ongoing system infrastructure improvement and replacement process aimed at lowering the potential of fires sparked by electric infrastructure. Over the next several years, Liberty will conduct the following improvements to support this process:

- Install covered conductors
- Replace conventional fuses with limiting fuses
- Test and replace aging poles
- Underground sections of the grid
- Remove tree attachments (electrical infrastructure attached to trees)
- Decommission the old wood structure Brockway Substation and replace with a new modern substation
- Complete system audit (inspect 100% of all poles and infrastructure in the system)

Vegetation Management

Liberty crews are deployed year-round throughout the region to inspect trees and vegetation in the vicinity of power lines. In compliance with state law and safety best practices, Liberty will trim or remove trees or branches that have grown too close to power lines in order to mitigate wildfire risk.

When trees are identified for trimming, crews are instructed to prune branches and vegetation back to a minimum of 12 feet from the high voltage power lines to maintain adequate clearance over the maintenance cycle period. Crews will additionally identify trees for removal that are dead, diseased, or structurally unsound, despite being within the acceptable clearance zone, if they have the potential to fall on power lines.

Customers should never attempt to conduct the tree trimming activities themselves, due to the risk of coming into contact with power lines during the process.

Liberty offers complimentary tree-trimming services to customers who believe a tree or branch may be hazardous to nearby electric infrastructure. If you spot a tree or branch you feel may be a hazard, please call us at 530-546-1787.

Important

If we have your current contact information, Liberty will be sending outreach updates to affected customers. If we don't have your current contact information on file, please email it to us immediately at: CustomerInfo@libertyutilities.com.

Please help to keep our customer service phone lines clear for emergencies.

Friday, November 22 Customer Communications (Morning)

The following message was distributed via OnSolve to impacted customers on Friday, November 22 at 7:30 AM:

Email:

This is an important alert from your electric provider, Liberty. Liberty continues to monitor extreme weather conditions that may increase the risk of a potential wildfire. Liberty may implement a Public Safety Power Shutoff (PSPS) for (Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker customers) on or about Friday, November 22, 2024, at about 5 a.m. The power shutoff could last more than 24 hours. If a PSPS is implemented, Liberty will notify customers.

In the event a PSPS is implemented, customers are encouraged to visit one of our two Community Resource Centers on Friday, November 22 from 8 a.m. -10 p.m. if they are unable to secure necessary alternative power. (1) The Woodfords Community Center, 96 Washoe Blvd. Markleeville, CA or (2) The Walker Community Center 442 Mule Deer Drive, Walker, CA.

Details of the PSPS can be found on our website and will be updated as necessary.

<https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

For additional updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA).

Phone/Text:

1. This is an important alert from your electric provider, Liberty. Liberty continues to monitor extreme weather conditions that increase the risk of a potential wildfire. Liberty may implement a Public Safety Power Shutoff (PSPS) for your area on or about Friday, November 22, 2024, at about 5 a.m. The power

shutoff could last more than 24 hours. In the event that a PSPS is implemented, Liberty will notify customers.

2. Customers are encouraged to visit one of our two Community Resource Centers on Friday, November 22 from 8 a.m. -10 p.m. if they are unable to secure necessary alternative power. (1) The Woodfords Community Center, 96 Washoe Blvd. Markleeville, CA or (2) The Walker Community Center 442 Mule Deer Drive, Walker, CA. Details of the PSPS can be found on our website.

The following messages were posted to Liberty's social media on Friday, November 22

*Twitter Thread: *numbers identify position in the thread*

1. Liberty continues to monitor extreme weather conditions that increase the risk of a potential wildfire. Liberty may implement a Public Safety Power Shutoff (PSPS) for **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker** customers. <attach map>
2. Customers are encouraged to plan ahead for the possibility of an extended power shutoff that may begin around 5:00 a.m. on Friday, November 22, 2024 and may last more than 24 hours. In the event that a PSPS is implemented, Liberty will notify customers.
3. Customers are encouraged to visit one of our two Community Resource Centers on Friday, November 22 from 8 a.m. -10 p.m. if they are unable to secure necessary alternative power. (1) The Woodfords Community Center, 96 Washoe Blvd., Markleeville, CA or (2) The Walker Community Center, 442 Mule Deer Drive, Walker, CA.
4. Further details can be found on our webpage: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Facebook Post:

Liberty continues to monitor extreme weather conditions that increase the risk of a potential wildfire. Liberty may implement a Public Safety Power Shutoff (PSPS) for **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker** customers. Customers are encouraged to plan ahead for the possibility of an extended power shutoff that may begin around 5:00 a.m. on Friday, November 22, 2024 that may last more than 24 hours. If a PSPS is implemented, Liberty will notify customers.

Customers are encouraged to visit one of our two Community Resource Centers on Friday, November 22 from 8 a.m. -10 p.m. if they are unable to secure necessary alternative power. (1) The Woodfords Community Center, 96 Washoe Blvd. Markleeville, CA or (2) The Walker Community Center 442 Mule Deer Drive, Walker, CA.

Further details can be found on our webpage: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

DE-ENERGIZATION IMPLEMENTED NOTIFICATIONS

Friday, November 22 Customer Communications (Morning)

The following message was distributed via OnSolve to impacted customers on Friday, November 22 at 8:06 AM:

Email:

This is an important alert from your electric provider, Liberty. Due to extreme weather conditions that increase the risk of a potential wildfire, a Public Safety Power Shutoff (PSPS) will be implemented immediately on Friday, November 22, 2024. The power shutoff could last more than 24 hours. Customers are encouraged to visit our Community Resource Centers from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, if they are unable to secure necessary alternative power.

Details of the PSPS can be found on our website and will be updated as necessary.

<https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

For additional updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA).

Phone/Text:

1. This is an important alert from your electric provider, Liberty. Due to extreme weather conditions that increase the risk of a potential wildfire, a Public Safety Power Shutoff (PSPS) will be implemented immediately on Friday, November 22.

2. Customers are encouraged to visit our Community Resource Centers from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, if they are unable to secure necessary alternative power. Details of the PSPS can be found on our website.

The following messages were posted to Liberty's social media on Friday, November 22 at 8:00 AM:

Social Media – All Customers

*Twitter Thread: *numbers identify position in the thread*

1. Liberty is implementing a Public Safety Power Shutoff (PSPS) for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker customers, due to extreme weather conditions that increase the risk of a potential wildfire. <attach map>
2. Customers will need to plan for an extended power shutoff that will begin at 8:00 a.m. on Friday, November 22, 2024, and could last more than 24 hours.
3. Customers are encouraged to visit our Community Resource Centers from 8 a.m. - 10 p.m. at the

Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, if they are unable to secure necessary alternative power.

4. Further details can be found on our webpage: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Facebook Post:

Liberty is implementing a Public Safety Power Shutoff (PSPS) for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker customers, due to extreme weather conditions that increase the risk of a potential wildfire. Customers will need to plan for an extended power shutoff that began at 8:00 a.m. on Friday, November 22, and could last more than 24 hours.

Customers are encouraged to visit our Community Resource Centers from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, if they are unable to secure necessary alternative power.

Further details can be found on our webpage: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

The following was update was made to Liberty's website on Friday, November 22

Public Safety Power Shutoff Update for Liberty Customers

Liberty is currently implementing a Public Safety Power Shutoff (PSPS) for [THESE AREAS](#) (Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker customers), due to extreme weather conditions that increase the risk of a potential wildfire. Customers will need to plan for an extended power shutoff that will begin at around 8:00 a.m. on Friday, November 22, and could last more than 24 hours.

Customers who are unable to secure necessary alternative power are encouraged to visit our Community Resource Centers from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA.

Monitored Fire Weather Conditions

Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

Energy Release Component	Wind Gusts	Fosberg Fire Weather Index
<20% safety threshold: 92nd percentile	>60 mph safety threshold: 40 mph	>80 safety threshold: 50

What Do I Need to Know?

- Power is expected to be shut off on or about Friday, November 22, 2024 at about 5:00 a.m.
- Predicted weather conditions warrant a PSPS forecasted for the aforementioned areas, date, and time.
- Approximately 1,490 customers will be impacted.
- Public safety partners were contacted on Thursday, November 21 and made aware of medically sensitive customers who will be impacted by the PSPS.
- Two Community Resource Centers (CRC) are being activated. The CRC will remain open during the event between the hours of 8 a.m. to 10 p.m. throughout the de-energization event to provide customers with resources.
- Customers who require power to operate life-essential medical equipment are strongly encouraged to visit our Community Resource Center from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA if they are unable to secure necessary alternative power.
- For additional information and real-time updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

View Areas Impacted by the PSPS [HERE](#)

When Will Power Be Restored?

Liberty will begin the process to restore power when weather conditions retreat below the aforementioned safety thresholds. The restoration process includes conducting safety inspections on power lines and electric infrastructure throughout the impacted communities, an essential action that must be completed prior to lifting the PSPS and restoring power. The power shutoff could last more than 24 hours. Thank you for your patience. We will provide additional updates as they become available.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-

energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If it is determined that the forecasted conditions meet or exceed safety thresholds, Liberty will initiate a PSPS.

Safety Thresholds:

- The Energy Release Component (measures dry fuel conditions) exceeds 92nd percentile
- Wind gusts exceed 40 miles per hour
- Fosberg Fire Weather Index (measures speed of potential fire) exceeds 50

In the event that a PSPS is a possibility, Liberty will attempt to contact customers through calls, texts, and emails using contact information on file. Customers should keep their contact information up-to-date and follow Liberty on Facebook and X to receive timely PSPS updates.

What Other Wildfire Mitigation Efforts Does Liberty Have in Place to Protect Our Community?

Catastrophic wildfires have become all too common in California. Due to the dense vegetation and dry brush that characterize much of our landscape, the Lake Tahoe Basin and surrounding forested areas have been designated either "High" or "Very High" Fire Hazard Severity Zones by CAL FIRE.

Liberty is taking steps to mitigate the risk of wildfires in the communities we serve. Outlined below are the key components of our Wildfire Mitigation Plan.

[View Mitigation Plan](#)

Infrastructure Hardening

Infrastructure hardening is an ongoing system infrastructure improvement and replacement process aimed at lowering the potential of fires sparked by electric infrastructure. Over the next several years, Liberty will conduct the following improvements to support this process:

- Install covered conductors
- Replace conventional fuses with limiting fuses
- Test and replace aging poles
- Underground sections of the grid
- Remove tree attachments (electrical infrastructure attached to trees)
- Decommission the old wood structure Brockway Substation and replace with a new modern substation
- Complete system audit (inspect 100% of all poles and infrastructure in the system)

Vegetation Management

Liberty crews are deployed year-round throughout the region to inspect trees and vegetation in the vicinity of power lines. In compliance with state law and safety best practices, Liberty will trim or remove trees or branches that have grown too close to power lines in order to mitigate wildfire risk.

When trees are identified for trimming, crews are instructed to prune branches and vegetation back to a minimum of 12 feet from the high voltage power lines to maintain adequate clearance over the maintenance cycle period. Crews will additionally identify trees for removal that are dead, diseased, or structurally unsound, despite being within the acceptable clearance zone, if they have the potential to fall on power lines.

Customers should never attempt to conduct the tree trimming activities themselves, due to the risk of coming into contact with power lines during the process.

Liberty offers complimentary tree-trimming services to customers who believe a tree or branch may be hazardous to nearby electric infrastructure. If you spot a tree or branch you feel may be a hazard, please call us at 530-546-1787.

Important

If we have your current contact information, Liberty will be sending outreach updates to affected customers. If we don't have your current contact information on file, please email it to us immediately at: CustomerInfo@libertyutilities.com.

Please help to keep our customer service phone lines clear for emergencies.

Friday, November 22 Customer Communications (Afternoon)

The following message was distributed via OnSolve to impacted customers on Friday, November 22 at 1:39 PM:

Email:

This is an important alert from your electric provider, Liberty. Due to extreme weather conditions that increase the risk of a potential wildfire, a Public Safety Power Shutoff (PSPS) will be implemented immediately on Friday, November 22, 2024. The power shutoff could last more than 24 hours. Customers are encouraged to visit our Community Resource Centers from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, if they are unable to secure necessary alternative power.

Details of the PSPS can be found on our website and will be updated as necessary.

<https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

For additional updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA).

Phone/Text:

1. This is an important alert from your electric provider, Liberty. Due to extreme weather conditions that increase the risk of a potential wildfire, a Public Safety Power Shutoff (PSPS) will be implemented immediately on Friday, November 22.
2. Customers are encouraged to visit our Community Resource Centers from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, if they are unable to secure necessary alternative power. Details of the PSPS can be found on our website.

The following messages were posted to Liberty's social media on Friday, November 22 at 1:42 AM:

Social Media – All Customers

*Twitter Thread: *numbers identify position in the thread*

1. Liberty is implementing a Public Safety Power Shutoff (PSPS) for some **Topaz, Coleville, and Walker customers**, due to extreme weather conditions that increase the risk of a potential wildfire. <attach map>
2. Customers will need to plan for an extended power shutoff that will begin at 1:20 p.m. on Friday, November 22, 2024, and could last more than 24 hours.
3. Customers are encouraged to visit our Community Resource Centers from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, if they are unable to secure necessary alternative power.
4. Further details can be found on our webpage:
<https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Facebook and Website Post:

Liberty is implementing a Public Safety Power Shutoff (PSPS) for some **Topaz, Coleville, and Walker customers**, due to extreme weather conditions that increase the risk of a potential wildfire. Customers will need to plan for an extended power shutoff that began at 1:20 p.m. on Friday, November 22, and could last more than 24 hours.

Customers are encouraged to visit our Community Resource Centers from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, if they are unable to secure necessary alternative power.

Further details can be found on our webpage: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

RESTORATION INITIATED NOTIFICATIONS

Topaz, Walker, Coleville

The following message was distributed via OnSolve to impacted customers on Friday, November 22 at 9:02 PM:

EMAIL:

Liberty crews are conducting inspections on power lines and electric infrastructure throughout the community. This is an essential action that must be completed prior to lifting the current Public Safety Power Shutoff (PSPS) and restoring power. Liberty expects to begin restoring power at approximately 12:30 am.

Thank you for your cooperation as we work to keep our communities safe.

The Community Resource Centers at Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, and Walker Community Center, 442 Mule Deer Drive, Walker, CA, will remain open until 10:00, as long as the PSPS is still in effect.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

Phone/Text:

1. Liberty crews are conducting safety inspections on power lines and electric infrastructure throughout the community, an essential action that must be completed prior to lifting the current Public Safety Power Shutoff (PSPS) and restoring power. We expect to begin restoring power at approximately 12:30 am Thank you for your cooperation as we work to keep our communities safe.

The Community Resource Centers at Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, and Walker Community Center, 442 Mule Deer Drive, Walker, CA, will remain open until 10:00, as long as the PSPS is still in effect. **For additional information and real-time updates**, please visit [libertyutilities.com](#) or follow us on Facebook (@LibertyUtilitiesLT) and Twitter (@LibertyUtil_CA).

The following messages were posted to Liberty's social media on Friday, November 22 at 8:55 PM:

Facebook and Media:

Liberty crews are conducting inspections on power lines and electric infrastructure throughout the **Topaz, Coleville, and Walker** communities. This is an essential action that must be completed before

lifting the current Public Safety Power Shutoff (PSPS) and restoring power. Liberty expects to begin restoring power at approximately 12:30 am

Thank you for your cooperation as we work to keep our communities safe.

The Community Resource Centers at Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, and Walker Community Center, 442 Mule Deer Drive, Walker, CA, will remain open until 10:00, as long as the PSPS is still in effect.

For additional information and real-time updates, please visit our [PSPS website](https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html)
<https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Twitter:

1. Liberty crews are conducting safety inspections on power lines and electric infrastructure throughout the **Topaz, Coleville, and Walker** communities. This is an essential action that must be completed before lifting the current Public Safety Power Shutoff (PSPS) and restoring power. Liberty expects to begin restoring power at approximately 12:30 am
2. Thank you for your cooperation as we work to keep our communities safe. The Community Resource Centers at Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, and Walker Community Center, 442 Mule Deer Drive, Walker, CA, will remain open until 10:00, as long as the PSPS is still in effect.
3. **For additional information and real-time updates**, please visit our [PSPS website](https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html)
<https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

The following was update was made to Liberty's website on Friday, November 22

Public Safety Power Shutoff Update for Liberty Customers

Liberty crews are conducting inspections on power lines and electric infrastructure throughout the Topaz, Coleville, and Walker communities. This is an essential action that must be completed prior to lifting the current Public Safety Power Shutoff (PSPS) and restoring power. Liberty expects to begin restoring power at approximately 12:30 a.m.

Thank you for your cooperation as we work to keep our communities safe.

Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

The Community Resource Centers at Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, and Walker Community Center, 442 Mule Deer Drive, Walker, CA, will remain open until 10:00, as long as the PSPS is still in effect.

Monitored Fire Weather Conditions		
Energy Release Component	Wind Gusts	Fosberg Fire Weather Index
<20% safety threshold: 92nd percentile	>60 mph safety threshold: 40 mph	>80 safety threshold: 50

What Do I Need to Know?

- Power is expected to be shut off on or about Wednesday, November 20, 2024, at about 2 a.m.
- Predicted weather conditions warrant a PSPS forecasted for the aforementioned areas, date, and time.
- Approximately 1,490 customers will be impacted.
- Public safety partners were contacted on Tuesday, November 19 and made aware of medically sensitive customers who will be impacted by the PSPS.
- Two Community Resource Centers (CRC) are being activated. The CRC will remain open during the event between the hours of 8 a.m. to 10 p.m. throughout the de-energization event to provide customers with resources.
- Customers who require power to operate life-essential medical equipment are strongly encouraged to visit our Community Resource Center from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA if they are unable to secure necessary alternative power.
- For additional information and real-time updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

View Areas Impacted by the PSPS [HERE](#)

When Will Power Be Restored?

Liberty will begin the process to restore power when weather conditions retreat below the aforementioned safety thresholds. The restoration process includes conducting safety inspections on power lines and electric infrastructure throughout the impacted communities, an essential action that must be completed prior to lifting the PSPS and restoring power. The power shutoff could last more than 24 hours. Thank you for your patience. We will provide additional updates as they become available.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If it is determined that the forecasted conditions meet or exceed safety thresholds, Liberty will initiate a PSPS.

Safety Thresholds:

- The Energy Release Component (measures dry fuel conditions) exceeds 92nd percentile
- Wind gusts exceed 40 miles per hour
- Fosberg Fire Weather Index (measures speed of potential fire) exceeds 50

In the event that a PSPS is a possibility, Liberty will attempt to contact customers through calls, texts, and emails using contact information on file. Customers should keep their contact information up-to-date and follow Liberty on Facebook and X to receive timely PSPS updates.

What Other Wildfire Mitigation Efforts Does Liberty Have in Place to Protect Our Community?

Catastrophic wildfires have become all too common in California. Due to the dense vegetation and dry brush that characterize much of our landscape, the Lake Tahoe Basin and surrounding forested areas have been designated either "High" or "Very High" Fire Hazard Severity Zones by CAL FIRE.

Liberty is taking steps to mitigate the risk of wildfires in the communities we serve. Outlined below are the key components of our Wildfire Mitigation Plan.

[View Mitigation Plan](#)

Infrastructure Hardening

Infrastructure hardening is an ongoing system infrastructure improvement and replacement process aimed at lowering the potential of fires sparked by electric infrastructure. Over the next several years, Liberty will conduct the following improvements to support this process:

- Install covered conductors

Liberty Utilities (CalPeco Electric) LLC Post Event Report on November 22, 2024, PSPS Event

- Replace conventional fuses with limiting fuses
- Test and replace aging poles
- Underground sections of the grid
- Remove tree attachments (electrical infrastructure attached to trees)
- Decommission the old wood structure Brockway Substation and replace with a new modern substation
- Complete system audit (inspect 100% of all poles and infrastructure in the system)

Vegetation Management

Liberty crews are deployed year-round throughout the region to inspect trees and vegetation in the vicinity of power lines. In compliance with state law and safety best practices, Liberty will trim or remove trees or branches that have grown too close to power lines in order to mitigate wildfire risk.

When trees are identified for trimming, crews are instructed to prune branches and vegetation back to a minimum of 12 feet from the high voltage power lines to maintain adequate clearance over the maintenance cycle period. Crews will additionally identify trees for removal that are dead, diseased, or structurally unsound, despite being within the acceptable clearance zone, if they have the potential to fall on power lines.

Customers should never attempt to conduct the tree trimming activities themselves, due to the risk of coming into contact with power lines during the process.

Liberty offers complimentary tree-trimming services to customers who believe a tree or branch may be hazardous to nearby electric infrastructure. If you spot a tree or branch you feel may be a hazard, please call us at 530-546-1787.

Important

If we have your current contact information, Liberty will be sending outreach updates to affected customers. If we don't have your current contact information on file, please email it to us immediately at: CustomerInfo@libertyutilities.com.

Please help to keep our customer service phone lines clear for emergencies.

RESTORATION INITIATED NOTIFICATIONS

Markleeville, Woodfords, and Desolation Hotel (Hope Valley)

The following message was distributed via OnSolve to impacted customers on Friday, November 22 at 6:53 PM:

EMAIL:

Liberty crews are conducting inspections on power lines and electric infrastructure throughout the community. This is an essential action that must be completed prior to lifting the current Public Safety Power Shutoff (PSPS) and restoring power. Liberty expects to begin restoring power at approximately 10:00 p.m.

Thank you for your cooperation as we work to keep our communities safe.

The Community Resource Center at Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, will remain open until 10:00, as long as the PSPS is still in effect.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

Phone/Text:

1. Liberty crews are conducting inspections on power lines and electric infrastructure throughout the community, an essential action that must be completed prior to lifting the current Public Safety Power Shutoff (PSPS) and restoring power. We expect to begin restoring power at approximately 1090 p.m. Thank you for your cooperation as we work to keep our communities safe.
2. The Community Resource Center at Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, will remain open until 10:00, as long as the PSPS is still in effect. **For additional information and real-time updates**, please visit [libertyutilities.com](#) or follow us on Facebook (@LibertyUtilitiesLT) and Twitter (@LibertyUtil_CA).

The following messages were posted to Liberty's social media on Friday, November 22 at 6:49 PM:

Facebook and Media:

Liberty crews are conducting inspections on power lines and electric infrastructure throughout the **Markleeville, Woodfords, and Desolation Hotel (Hope Valley) communities**. This is an essential action that must be completed before lifting the current Public Safety Power Shutoff (PSPS) and restoring power. Liberty expects to begin restoring power at approximately 10:00 p.m.

Thank you for your cooperation as we work to keep our communities safe.

The Community Resource Centers at Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, and Walker Community Center, 442 Mule Deer Drive, Walker, CA, will remain open until 10:00 p.m., as long as the PSPS is still in effect.

For additional information and real-time updates, please visit our [PSPS website](https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html) <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Twitter:

1. Liberty crews are conducting safety inspections on power lines and electric infrastructure throughout the Markleeville, Woodfords, and Desolation Hotel (Hope Valley) communities. This is an essential action that must be completed before lifting the current Public Safety Power Shutoff (PSPS) and restoring power. Liberty expects to begin restoring power at approximately 10:00 p.m.
2. Thank you for your cooperation as we work to keep our communities safe. The Community Resource Centers at Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, and Walker Community Center, 442 Mule Deer Drive, Walker, CA, will remain open until 10:00 p.m., as long as the PSPS is still in effect.
3. **For additional information and real-time updates**, please visit our [PSPS website](https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html) <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

The following was update was made to Liberty’s website on Friday, November 22 at 6:44 PM:

Public Safety Power Shutoff Update for Liberty Customers

November 22, 6:30 PM update:

Liberty crews are conducting inspections on power lines and electric infrastructure throughout the Markleeville, Woodfords, and Desolation Hotel (Hope Valley) communities. This is an essential action that must be completed prior to lifting the current Public Safety Power Shutoff (PSPS) and restoring power. Liberty expects to begin restoring power at approximately 10:00 p.m.

Thank you for your cooperation as we work to keep our communities safe.

The Community Resource Center at Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, and Walker Community Center, 442 Mule Deer Drive, Walker, CA, will remain open until 10:00, as long as the PSPS is still in effect.

Monitored Fire Weather Conditions		
Energy Release Component	Wind Gusts	Fosberg Fire Weather Index
<20% safety threshold: 92nd percentile	>60 mph safety threshold: 40 mph	>80 safety threshold: 50

What Do I Need to Know?

- Power is expected to be shut off on or about Wednesday, November 20, 2024, at about 2 a.m.
- Predicted weather conditions warrant a PSPS forecasted for the aforementioned areas, date, and time.
- Approximately 1,490 customers will be impacted.
- Public safety partners were contacted on Tuesday, November 19 and made aware of medically sensitive customers who will be impacted by the PSPS.
- Two Community Resource Centers (CRC) are being activated. The CRC will remain open during the event between the hours of 8 a.m. to 10 p.m. throughout the de-energization event to provide customers with resources.
- Customers who require power to operate life-essential medical equipment are strongly encouraged to visit our Community Resource Center from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA if they are unable to secure necessary alternative power.
- For additional information and real-time updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

View Areas Impacted by the PSPS [HERE](#)

When Will Power Be Restored?

Liberty will begin the process to restore power when weather conditions retreat below the aforementioned safety thresholds. The restoration process includes conducting safety inspections on power lines and electric infrastructure throughout the impacted communities, an essential action that must be completed prior to lifting the PSPS and restoring power. The power shutoff could last more than 24 hours. Thank you for your patience. We will provide additional updates as they become available.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If it is determined that the forecasted conditions meet or exceed safety thresholds, Liberty will initiate a PSPS.

Safety Thresholds:

- The Energy Release Component (measures dry fuel conditions) exceeds 92nd percentile
- Wind gusts exceed 40 miles per hour
- Fosberg Fire Weather Index (measures speed of potential fire) exceeds 50

In the event that a PSPS is a possibility, Liberty will attempt to contact customers through calls, texts, and emails using contact information on file. Customers should keep their contact information up-to-date and follow Liberty on Facebook and X to receive timely PSPS updates.

What Other Wildfire Mitigation Efforts Does Liberty Have in Place to Protect Our Community?

Catastrophic wildfires have become all too common in California. Due to the dense vegetation and dry brush that characterize much of our landscape, the Lake Tahoe Basin and surrounding forested areas have been designated either "High" or "Very High" Fire Hazard Severity Zones by CAL FIRE.

Liberty is taking steps to mitigate the risk of wildfires in the communities we serve. Outlined below are the key components of our Wildfire Mitigation Plan.

[View Mitigation Plan](#)

Infrastructure Hardening

Infrastructure hardening is an ongoing system infrastructure improvement and replacement process aimed at lowering the potential of fires sparked by electric infrastructure. Over the next several years, Liberty will conduct the following improvements to support this process:

- Install covered conductors
- Replace conventional fuses with limiting fuses
- Test and replace aging poles
- Underground sections of the grid
- Remove tree attachments (electrical infrastructure attached to trees)
- Decommission the old wood structure Brockway Substation and replace with a new modern substation

- Complete system audit (inspect 100% of all poles and infrastructure in the system)

Vegetation Management

Liberty crews are deployed year-round throughout the region to inspect trees and vegetation in the vicinity of power lines. In compliance with state law and safety best practices, Liberty will trim or remove trees or branches that have grown too close to power lines in order to mitigate wildfire risk.

When trees are identified for trimming, crews are instructed to prune branches and vegetation back to a minimum of 12 feet from the high voltage power lines to maintain adequate clearance over the maintenance cycle period. Crews will additionally identify trees for removal that are dead, diseased, or structurally unsound, despite being within the acceptable clearance zone, if they have the potential to fall on power lines.

Customers should never attempt to conduct the tree trimming activities themselves, due to the risk of coming into contact with power lines during the process.

Liberty offers complimentary tree-trimming services to customers who believe a tree or branch may be hazardous to nearby electric infrastructure. If you spot a tree or branch you feel may be a hazard, please call us at 530-546-1787.

Important

If we have your current contact information, Liberty will be sending outreach updates to affected customers. If we don't have your current contact information on file, please email it to us immediately at: CustomerInfo@libertyutilities.com.

Please help to keep our customer service phone lines clear for emergencies.

RESTORATION COMPLETE NOTIFICATIONS

Topaz, Walker, Coleville

The following message was distributed via OnSolve to impacted customers on Friday, November 22 at 9:59 PM:

ONSOLVE: Customer in Power

This is an important alert from your electric provider, Liberty.

Liberty crews conducted inspections on the affected power lines and power has been restored.

If you are still experiencing a power outage, please contact us at 1-844-245-6868.

We appreciate your understanding as we took this proactive measure to keep the community safe.

The following messages were posted to Liberty's website and social media on Friday, November 22 at 10:00 PM:

We have restored power to **Topaz, Coleville, and Walker** communities following the extreme weather conditions that necessitated a Public Safety Power Shutoff (PSPS). Liberty crews conducted inspections on the affected power lines and confirmed the grid could be safely re-energized.

We appreciate your understanding as we took this proactive measure to keep the community safe.

RESTORATION COMPLETE NOTIFICATIONS

Markleeville, Woodfords, and Desolation Hotel (Hope Valley)

The following message was distributed via OnSolve to impacted customers on Friday, November 22 at 8:24 PM:

ONSOLVE: Customer in Power

This is an important alert from your electric provider, Liberty.

Liberty crews conducted inspections on the affected power lines and power has been restored.

If you are still experiencing a power outage, please contact us at 1-844-245-6868.

We appreciate your understanding as we took this proactive measure to keep the community safe.

The following messages were posted to Liberty's website and social media on Friday, November 22 at 8:16 PM:

We have restored power to most of the **Markleeville, Woodfords, and Desolation Hotel (Hope Valley)** communities following the extreme weather conditions that necessitated a Public Safety Power Shutoff (PSPS).

We appreciate your understanding as we took this proactive measure to keep the community safe.

ADDITIONAL EVENT CONCLUDED NOTIFICATIONS

Topaz, Walker, Coleville

The following message was distributed via OnSolve to impacted customers on Friday, November 22 at 10:01 PM:

OnSolve – Impacted Customers

Email

This is an important alert from your electric provider, Liberty. The weather conditions have improved. The Public Safety Power Shutoff (PSPS) considered for the **Topaz, Coleville, and Walker area** has concluded.

Liberty continues to monitor the situation closely. Protecting the safety of our customers and the community is our top priority, and we appreciate your patience and cooperation.

For additional updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA) or visit our website at libertyutilities.com.

Phone/Text

1. This is an important alert from your electric provider, Liberty. The Public Safety Power Shutoff (PSPS) considered for your area has concluded in light of improved weather conditions. Liberty continues to monitor the situation closely. Protecting the safety of our customers and the community is our top priority, and we appreciate your patience and cooperation.
2. For additional updates, please follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA) or visit our website at libertyutilities.com.

15 Appendix B – Public Safety Partner Notifications

Nicholas Raft

From: Jennifer Guenther
Sent: Friday, November 22, 2024 8:14 PM
To: mbeckwith@alpinecountyca.gov; tminder@alpineso.com; nwilliamson@alpinecountyca.gov; rjohnson@alpinecountyca.gov; Terry Hughes; tstreeper@alpinecountyca.gov; cgoodman@alpinecountyca.gov; ken.quiner@washoetribe.us; rob.beltramo@washoetribe.us; lisa.christensen@washoetribe.us; George.abbott@washoetribe.us; max.rettig@washoetribe.us; aslais@alpinecountyca.gov; charootunian@alpineso.com; jbaker@alpineso.com; pwasham@alpinecountyca.gov; Ken Burkhart; Shane Gleason; htorix@esud.org; scottndeb1951@outlook.com; Ethan Gray; David Griffith; rhames@alpinecountyca.gov; geoff.ellis@washoetribe.us
Cc: Lee Kiolbasa; Kate Marrone; Matt Newberry
Subject: RE: Notice of RESTORATION Public Safety Power Shutoff from Liberty for Markleeville, Woodfords, Desolation Hotel (Hope Valley) area customers

We have restored power to most of the **Markleeville, Woodfords, and Desolation Hotel (Hope Valley)** communities following the extreme weather conditions that necessitated a Public Safety Power Shutoff (PSPS).

We appreciate your understanding as we took this proactive measure to keep the community safe.

Jennifer Guenther | [Liberty Utilities \(West Region\)](#) | Senior Manager, Customer Solutions
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther
Sent: Friday, November 22, 2024 6:42 PM
To: 'mbeckwith@alpinecountyca.gov' <mbeckwith@alpinecountyca.gov>; 'tminder@alpineso.com' <tminder@alpineso.com>; 'nwilliamson@alpinecountyca.gov' <nwilliamson@alpinecountyca.gov>; 'rjohnson@alpinecountyca.gov' <rjohnson@alpinecountyca.gov>; Terry Hughes <athughes75@hotmail.com>; 'tstreeper@alpinecountyca.gov' <tstreeper@alpinecountyca.gov>; 'cgoodman@alpinecountyca.gov' <cgoodman@alpinecountyca.gov>; 'ken.quiner@washoetribe.us' <ken.quiner@washoetribe.us>; 'rob.beltramo@washoetribe.us' <rob.beltramo@washoetribe.us>; 'lisa.christensen@washoetribe.us' <lisa.christensen@washoetribe.us>; 'George.abbott@washoetribe.us' <George.abbott@washoetribe.us>; 'max.rettig@washoetribe.us' <max.rettig@washoetribe.us>; 'aslais@alpinecountyca.gov' <aslais@alpinecountyca.gov>; 'charootunian@alpineso.com' <charootunian@alpineso.com>; 'jbaker@alpineso.com' <jbaker@alpineso.com>; 'pwasham@alpinecountyca.gov' <pwasham@alpinecountyca.gov>; 'Ken Burkhart' <kburkhart@alpinestudents.org>; Shane Gleason <sgleason@esud.org>; 'htorix@esud.org' <htorix@esud.org>; 'scottndeb1951@outlook.com' <scottndeb1951@outlook.com>; 'Ethan Gray' <egray@alpinecountyca.gov>; 'David Griffith' <dgriffith.9@gmail.com>; 'rhames@alpinecountyca.gov' <rhames@alpinecountyca.gov>; 'geoff.ellis@washoetribe.us' <geoff.ellis@washoetribe.us>
Cc: Lee Kiolbasa <Leonard.Kiolbasa@libertyutilities.com>; Kate Marrone <Kate.Marrone@libertyutilities.com>; Matt Newberry <Matt.Newberry@libertyutilities.com>
Subject: RE: Notice of RESTORATION INITIATED Public Safety Power Shutoff from Liberty for Markleeville, Woodfords, Desolation Hotel (Hope Valley) area customers

Liberty crews are conducting safety inspections on power lines and electric infrastructure throughout the **Markleeville, Woodfords, and Desolation Hotel (Hope Valley)** communities. This is an essential action that must be completed before lifting the current Public Safety Power Shutoff (PSPS) and restoring power. Liberty expects to begin restoring power at approximately 10:00 p.m.

Thank you for your cooperation as we work to keep our communities safe.

The Community Resource Centers at Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, and Walker Community Center, 442 Mule Deer Drive, Walker, CA, will remain open until 10:00, as long as the PSPS is still in effect.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

Jennifer Guenther | [Liberty Utilities \(West Region\)](#) | Senior Manager, Customer Solutions
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther
Sent: Friday, November 22, 2024 7:59 AM
To: mbeckwith@alpinecountyca.gov; tminder@alpineso.com; nwilliamson@alpinecountyca.gov; rjohnson@alpinecountyca.gov; Terry Hughes <athughes75@hotmail.com>; tstreeper@alpinecountyca.gov; cgoodman@alpinecountyca.gov; ken.quiner@washoetribe.us; rob.beltramo@washoetribe.us; lisa.christensen@washoetribe.us; George.abbott@washoetribe.us; max.rettig@washoetribe.us; aslais@alpinecountyca.gov; charootunian@alpineso.com; jbaker@alpineso.com; pwasham@alpinecountyca.gov; Ken Burkhardt <kburkhart@alpinestudents.org>; Shane Gleason <sgleason@esUSD.org>; htorix@esUSD.org; scottndeb1951@outlook.com; Ethan Gray <egrays@alpinecountyca.gov>; David Griffith <dgriffith.9@gmail.com>; rhammes@alpinecountyca.gov; geoff.ellis@washoetribe.us
Cc: Lee Kiolbasa <Leonard.Kiolbasa@libertyutilities.com>; Kate Marrone <Kate.Marrone@libertyutilities.com>; Matt Newberry <Matt.Newberry@libertyutilities.com>
Subject: RE: Notice of ACTIVE Public Safety Power Shutoff from Liberty for Markleeville, Woodfords, Desolation Hotel (Hope Valley) area customers

Liberty is currently implementing a Public Safety Power Shutoff (PSPS) for **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker customers**, due to extreme weather conditions that increase the risk of a potential wildfire. Customers will need to plan for an extended power shutoff that will begin at 8:00 a.m. on Friday, November 22, and could last more than 24 hours.

Customers are encouraged to visit our Community Resource Centers from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, if they are unable to secure necessary alternative power.

Further details can be found on our webpage: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Jennifer Guenther | [Liberty Utilities \(West Region\)](#) | Senior Manager, Customer Solutions
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther
Sent: Friday, November 22, 2024 7:43 AM
To: 'mbeckwith@alpinecountyca.gov' <mbeckwith@alpinecountyca.gov>; 'tminder@alpineso.com' <tminder@alpineso.com>; 'nwilliamson@alpinecountyca.gov' <nwilliamson@alpinecountyca.gov>; 'rjohnson@alpinecountyca.gov' <rjohnson@alpinecountyca.gov>; Terry Hughes <athughes75@hotmail.com>; 'tstreeper@alpinecountyca.gov' <tstreeper@alpinecountyca.gov>; 'cgoodman@alpinecountyca.gov' <cgoodman@alpinecountyca.gov>; 'ken.quiner@washoetribe.us' <ken.quiner@washoetribe.us>; 'rob.beltramo@washoetribe.us' <rob.beltramo@washoetribe.us>; 'lisa.christensen@washoetribe.us' <lisa.christensen@washoetribe.us>; 'George.abbott@washoetribe.us' <George.abbott@washoetribe.us>; 'max.rettig@washoetribe.us' <max.rettig@washoetribe.us>; 'aslais@alpinecountyca.gov' <aslais@alpinecountyca.gov>;

'charootunian@alpineso.com' <charootunian@alpineso.com>; 'jbaker@alpineso.com' <jbaker@alpineso.com>; 'pwasham@alpinecountyca.gov' <pwasham@alpinecountyca.gov>; 'Ken Burkhart' <kburkhart@alpinestudents.org>; Shane Gleason <sgleason@esUSD.org>; 'htorix@esUSD.org' <htorix@esUSD.org>; 'scottndeb1951@outlook.com' <scottndeb1951@outlook.com>; 'Ethan Gray' <egrays@alpinecountyca.gov>; 'David Griffith' <dgriffith.9@gmail.com>; 'rhames@alpinecountyca.gov' <rhames@alpinecountyca.gov>; 'geoff.ellis@washoeTribe.us' <geoff.ellis@washoeTribe.us>

Cc: Lee Kiolbasa <Leonard.Kiolbasa@libertyutilities.com>; Kate Marrone <Kate.Marrone@libertyutilities.com>; Matt Newberry <Matt.Newberry@libertyutilities.com>

Subject: RE: Notice of Potential Public Safety Power Shutoff from Liberty for Markleeville, Woodfords, Desolation Hotel (Hope Valley) area customers

Subject: Notice of Potential Public Safety Power Shutoff from Liberty for Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker area customers

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key audiences regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Friday, November 22, at 5:00 a.m.
- **Expected duration of PSPS outage:** from 7-24 hours
- **Number of customers potentially impacted:** Approximately 1,490 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers on Friday, November 22 from 8 a.m. – 10 p.m. The Woodfords Community Center, 96 Washoe Blvd., Markleeville, CA and Walker Community Center, 442 Mule Deer Drive, Walker, CA that will remain open throughout the PSPS. Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform).

In addition, [here is the website with PSPS information in multiple languages.](#)

Thank you for your support and cooperation as we work to keep our customers and communities safe.

Thank you to those of you who were able to join our partners call last night. In response to the comment that some customers do not understand what a PSPS is, below you will find links to videos and attached informational materials.

[What is a PSPS? Video](#)

[PSPS Criteria Video](#)

Jennifer Guenther | Liberty Utilities (West Region) | Senior Manager, Customer Solutions
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther

Sent: Thursday, November 21, 2024 9:54 AM

To: mbeckwith@alpinecountyca.gov; tminder@alpineso.com; nwilliamson@alpinecountyca.gov; rjohnson@alpinecountyca.gov; Terry Hughes <athughes75@hotmail.com>; tstreeper@alpinecountyca.gov; cgoodman@alpinecountyca.gov; ken.quiner@washoetribe.us; rob.beltramo@washoetribe.us; lisa.christensen@washoetribe.us; George.abbott@washoetribe.us; max.rettig@washoetribe.us; aslais@alpinecountyca.gov; charootunian@alpineso.com; jbaker@alpineso.com; pwasham@alpinecountyca.gov; Ken Burkhart <kburkhart@alpinestudents.org>; Shane Gleason <sgleason@esUSD.org>; htorix@esUSD.org; scottndeb1951@outlook.com; Ethan Gray <egray@alpinecountyca.gov>; David Griffith <dgriffith.9@gmail.com>; rhames@alpinecountyca.gov; geoff.ellis@washoetribe.us

Cc: Lee Kiolbasa <Leonard.Kiolbasa@libertyutilities.com>; Kate Marrone <Kate.Marrone@libertyutilities.com>; Matt Newberry <Matt.Newberry@libertyutilities.com>

Subject: Notice of Potential Public Safety Power Shutoff from Liberty for Markleeville, Woodfords, Desolation Hotel (Hope Valley) area customers

Importance: High

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key audiences regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Friday, November 22, at **8:00 a.m.**
- **Expected duration of PSPS outage:** from 7-24 hours

- **Number of customers potentially impacted:** Approximately 1,490 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers on Friday, November 22 from 8 a.m. – 10 p.m. The Woodfords Community Center, 96 Washoe Blvd., Markleeville, CA and Walker Community Center, 442 Mule Deer Drive, Walker, CA that will remain open throughout the PSPS. Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform).

In addition, [here is the website with PSPS information in multiple languages](#).

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

Jennifer Guenther | [Liberty Utilities \(West Region\)](#) | Senior Manager, Customer Solutions
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

Nicholas Raft

From: Jennifer Guenther
Sent: Friday, November 22, 2024 9:53 PM
To: John Peters; Sandra Moberly; htorix@esUSD.org; Shane Gleason; scottndeb1951@outlook.com; Cathy Young; Bri Chappell-McGovern; Cassidy Miles; Seth Clark; curtiranch@gmail.com; rcnald54@gmail.com; Michael Lightfoot; andrew.oddo@usmc.mil; ibraun@monosheriff.org; bbullock@mono.ca.gov; sroberts@monosheriff.org; Kathy Peterson; mmartinez@mono.ca.gov; Chris Mokrcek; lgaunt@mono.ca.gov; yfreeman@mono.ca.gov; cert4av@gmail.com
Cc: Matt Newberry; Kate Marrone; Lee Kiolbasa
Subject: RE: Notice of RESTORATION Safety Power Shutoff from Liberty for Topaz, Coleville, and Walker area customers
Attachments: Topaz_Muller_Reenergized.pdf

We have restored power to **Topaz, Coleville, and Walker** communities following the extreme weather conditions that necessitated a Public Safety Power Shutoff (PSPS). Liberty crews conducted inspections on the affected power lines and confirmed the grid could be safely re-energized.

We appreciate your understanding as we took this proactive measure to keep the community safe.

Jennifer Guenther | [Liberty Utilities \(West Region\)](#) | Senior Manager, Customer Solutions
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther
Sent: Friday, November 22, 2024 8:55 PM
To: John Peters <jpeters@mono.ca.gov>; Sandra Moberly <smoberly@mono.ca.gov>; htorix@esUSD.org; Shane Gleason <sgleason@esUSD.org>; scottndeb1951@outlook.com; Cathy Young <cyoung@mono.ca.gov>; Bri Chappell-McGovern <bchappell-mcgovern@mono.ca.gov>; Cassidy Miles <cmiles@mono.ca.gov>; Seth Clark <sclark@monosheriff.org>; curtiranch@gmail.com; rcnald54@gmail.com; Michael Lightfoot <michael.l.lightfoot@usmc.mil>; andrew.oddo@usmc.mil; ibraun@monosheriff.org; bbullock@mono.ca.gov; sroberts@monosheriff.org; Kathy Peterson <kpeterson@mono.ca.gov>; mmartinez@mono.ca.gov; Chris Mokrcek <cmokrcek@mono.ca.gov>; lgaunt@mono.ca.gov; yfreeman@mono.ca.gov; cert4av@gmail.com
Cc: Matt Newberry <Matt.Newberry@libertyutilities.com>; Kate Marrone <Kate.Marrone@libertyutilities.com>; Lee Kiolbasa <Leonard.Kiolbasa@libertyutilities.com>
Subject: RE: Notice of RESTORATION INITIATED Safety Power Shutoff from Liberty for Topaz, Coleville, and Walker area customers

Liberty crews are conducting inspections on power lines and electric infrastructure throughout the **Topaz, Coleville, and Walker** communities. This is an essential action that must be completed before lifting the current Public Safety Power Shutoff (PSPS) and restoring power. Liberty expects to begin restoring power at approximately 12:30 am.

Thank you for your cooperation as we work to keep our communities safe.

The Community Resource Centers at Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, and Walker Community Center, 442 Mule Deer Drive, Walker, CA, will remain open until 10:00, as long as the PSPS is still in effect.

For additional information and real-time updates, please visit our [PSPS website](#) or follow us on [Facebook](#) (@LibertyUtilitiesLT) and [X](#) (@LibertyUtil_CA)

Jennifer Guenther | Liberty Utilities (West Region) | Senior Manager, Customer Solutions
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther

Sent: Friday, November 22, 2024 1:46 PM

To: John Peters <jpeters@mono.ca.gov>; Sandra Moberly <smoberly@mono.ca.gov>; htorix@esusd.org; Shane Gleason <sgleason@esusd.org>; scottndeb1951@outlook.com; Cathy Young <cyoung@mono.ca.gov>; Bri Chappell-McGovern <bchappell-mcgovern@mono.ca.gov>; Cassidy Miles <cmiles@mono.ca.gov>; Seth Clark <sclark@monosheriff.org>; curtiranch@gmail.com; rcnalders54@gmail.com; Michael Lightfoot <michael.l.lightfoot@usmc.mil>; andrew.oddo@usmc.mil; ibraun@monosheriff.org; bullock@mono.ca.gov; sroberts@monosheriff.org; Kathy Peterson <kpeterston@mono.ca.gov>; mmartinez@mono.ca.gov; Chris Mokracek <cmokracek@mono.ca.gov>; lgaunt@mono.ca.gov; yfreeman@mono.ca.gov; cert4av@gmail.com

Cc: Matt Newberry <Matt.Newberry@libertyutilities.com>; Kate Marrone <Kate.Marrone@libertyutilities.com>; Lee Kiolbasa <Leonard.Kiolbasa@libertyutilities.com>

Subject: RE: Notice of Active Safety Power Shutoff from Liberty for Topaz, Coleville, and Walker area customers

Liberty is currently implementing a Public Safety Power Shutoff (PSPS) for some **Topaz, Coleville, and Walker customers**, due to extreme weather conditions that increase the risk of a potential wildfire. Customers will need to plan for an extended power shutoff that will begin at 1:20 p.m. on Friday, November 22, and could last more than 24 hours.

Customers are encouraged to visit our Community Resource Centers from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, if they are unable to secure necessary alternative power.

Further details can be found on our webpage: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Jennifer Guenther | Liberty Utilities (West Region) | Senior Manager, Customer Solutions
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther

Sent: Friday, November 22, 2024 8:01 AM

To: John Peters <jpeters@mono.ca.gov>; Sandra Moberly <smoberly@mono.ca.gov>; htorix@esusd.org; Shane Gleason <sgleason@esusd.org>; scottndeb1951@outlook.com; Cathy Young <cyoung@mono.ca.gov>; Bri Chappell-McGovern <bchappell-mcgovern@mono.ca.gov>; Cassidy Miles <cmiles@mono.ca.gov>; Seth Clark <sclark@monosheriff.org>; curtiranch@gmail.com; rcnalders54@gmail.com; Michael Lightfoot <michael.l.lightfoot@usmc.mil>; andrew.oddo@usmc.mil; ibraun@monosheriff.org; bullock@mono.ca.gov; sroberts@monosheriff.org; Kathy Peterson <kpeterston@mono.ca.gov>; mmartinez@mono.ca.gov; Chris Mokracek <cmokracek@mono.ca.gov>; lgaunt@mono.ca.gov; yfreeman@mono.ca.gov; cert4av@gmail.com

Subject: RE: Notice of Active Safety Power Shutoff from Liberty for Topaz, Coleville, and Walker area customers

Liberty is currently implementing a Public Safety Power Shutoff (PSPS) for **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker customers**, due to extreme weather conditions that increase the risk of a potential wildfire. Customers will need to plan for an extended power shutoff that will begin at 8:00 a.m. on Friday, November 22, and could last more than 24 hours.

Customers are encouraged to visit our Community Resource Centers from 8 a.m. - 10 p.m. at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA, or at the Walker Community Center, 442 Mule Deer Drive, Walker, CA, if they are unable to secure necessary alternative power.

Further details can be found on our webpage: <https://california.libertyutilities.com/south-lake-tahoe/residential/emergencies/electrical/public-safety-power-shutoff-update.html>

Jennifer Guenther | Liberty Utilities (West Region) | Senior Manager, Customer Solutions
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther

Sent: Friday, November 22, 2024 7:44 AM

To: John Peters <jpeters@mono.ca.gov>; Sandra Moberly <smoberly@mono.ca.gov>; htorix@esusd.org; Shane Gleason <sgleason@esusd.org>; scottndeb1951@outlook.com; Cathy Young <cyoung@mono.ca.gov>; Bri Chappell-McGovern <bchappell-mcgovern@mono.ca.gov>; Cassidy Miles <cmiles@mono.ca.gov>; Seth Clark <sclark@monosheriff.org>; curtiranch@gmail.com; rcnalders54@gmail.com; Michael Lightfoot <michael.l.lightfoot@usmc.mil>; andrew.oddo@usmc.mil; ibraun@monosheriff.org; bbullock@mono.ca.gov; sroberts@monosheriff.org; Kathy Peterson <kpeterson@mono.ca.gov>; mmartinez@mono.ca.gov; Chris Mokracek <cmokracek@mono.ca.gov>; lgaunt@mono.ca.gov; yfreeman@mono.ca.gov; cert4av@gmail.com

Subject: RE: Notice of Public Safety Power Shutoff from Liberty for Topaz, Coleville, and Walker area customers

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key audiences regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Friday, November 22, at **8:00 a.m.**
- **Expected duration of PSPS outage:** from 7-24 hours
- **Number of customers potentially impacted:** Approximately 1,490 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers on Friday, November 22 from 8 a.m. – 10 p.m. The Woodfords Community Center, 96 Washoe Blvd., Markleeville, CA and Walker Community Center, 442 Mule Deer Drive, Walker, CA that will remain open throughout the PSPS. Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform).

In addition, [here is the website with PSPS information in multiple languages.](#)

Thank you for your support and cooperation as we work to keep our customers and communities safe.

Jennifer Guenther | [Liberty Utilities \(West Region\)](#) | Senior Manager, Customer Solutions
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

From: Jennifer Guenther

Sent: Thursday, November 21, 2024 9:56 AM

To: John Peters <jpeters@mono.ca.gov>; 'Sandra Moberly' <smoberly@mono.ca.gov>; 'htorix@esUSD.org' <htorix@esUSD.org>; Shane Gleason <sgleason@esUSD.org>; 'scottndeb1951@outlook.com' <scottndeb1951@outlook.com>; 'Cathy Young' <cyoung@mono.ca.gov>; 'Bri Chappell-McGovern' <bchappell-mcgovern@mono.ca.gov>; 'Cassidy Miles' <cmiles@mono.ca.gov>; Seth Clark <sclark@monosheriff.org>; 'curtiranch@gmail.com' <curtiranch@gmail.com>; 'rcnalder54@gmail.com' <rcnalder54@gmail.com>; Michael Lightfoot <michael.l.lightfoot@usmc.mil>; 'andrew.oddo@usmc.mil' <andrew.oddo@usmc.mil>; 'ibraun@monosheriff.org' <ibraun@monosheriff.org>; 'bbullock@mono.ca.gov' <bbullock@mono.ca.gov>; 'sroberts@monosheriff.org' <sroberts@monosheriff.org>; 'Kathy Peterson' <kpeterson@mono.ca.gov>; 'mmartinez@mono.ca.gov' <mmartinez@mono.ca.gov>; 'Chris Mokracek' <cmokracek@mono.ca.gov>; 'lgaunt@mono.ca.gov' <lgaunt@mono.ca.gov>; 'yfreeman@mono.ca.gov' <yfreeman@mono.ca.gov>; 'cert4av@gmail.com' <cert4av@gmail.com>

Subject: Notice of Potential Public Safety Power Shutoff from Liberty for Topaz, Coleville, and Walker area customers

Importance: High

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key audiences regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Friday, November 22, at 5:00 a.m.
- **Expected duration of PSPS outage:** from 7-24 hours

- **Number of customers potentially impacted:** Approximately 1,490 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers on Friday, November 22 from 8 a.m. – 10 p.m. The Woodfords Community Center, 96 Washoe Blvd., Markleeville, CA and Walker Community Center, 442 Mule Deer Drive, Walker, CA that will remain open throughout the PSPS. Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform).

In addition, [here is the website with PSPS information in multiple languages](#).

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

Jennifer Guenther | [Liberty Utilities \(West Region\)](#) | Senior Manager, Customer Solutions
P: 530-721-1861 | E: Jennifer.Guenther@libertyutilities.com

Public Safety Partner Briefing Invitation - Sent 11/21/24 @3:14 PM

Stage: Updated Notice / Monitoring Potential PSPS

Nicholas Raft

Subject: Public Safety Partners Briefing: Liberty Potential PSPS 11/22/24
Location: Microsoft Teams Meeting

Start: Thu 11/21/2024 5:00 PM
End: Thu 11/21/2024 6:00 PM
Show Time As: Tentative

Recurrence: (none)

Meeting Status: Not yet responded

Organizer: Jennifer Guenther

Required Attendees: mbeckwith@alpinecountyca.gov; tminder@alpineso.com; nwilliamson@alpinecountyca.gov; rjohnson@alpinecountyca.gov; tstreeper@alpinecountyca.gov; cgoodman@alpinecountyca.gov; ken.quiner@washoetribe.us; rob.beltramo@washoetribe.us; lisa.christensen@washoetribe.us; George.abbott@washoetribe.us; max.rettig@washoetribe.us; aslais@alpinecountyca.gov; charootunian@alpineso.com; jbaker@alpineso.com; pwasham@alpinecountyca.gov; Ken Burkhart; Shane Gleason; htorix@esusd.org; Ethan Gray; David Griffith; rhames@alpinecountyca.gov; geoff.ellis@washoetribe.us; John Peters; 'Sandra Moberly'; 'Cathy Young'; 'Bri Chappell-McGovern'; 'Cassidy Miles'; Seth Clark; Michael Lightfoot; 'andrew.oddo@usmc.mil'; 'ibraun@monosheriff.org'; 'bbullock@mono.ca.gov'; 'sroberts@monosheriff.org'; 'Kathy Peterson'; 'mmartinez@mono.ca.gov'; 'Chris Mokracek'; 'lgaunt@mono.ca.gov'; 'yfreeman@mono.ca.gov'; Lee Kiolbasa; Peter Stoltman; Brian Mallett; Chris Lautenberger; Chad Sousa

Optional Attendees: Stephen Moore; Kate Marrone; Matt Newberry

Liberty, Mono County and Alpine County public safety partner meeting to provide updates for the potential Public Safety Power Shutoff (PSPS).

This is an important alert from the local electric provider, Liberty. Please be advised of a potential Public Safety Power Shutoff (PSPS) event for Liberty's customers in **Markleeville, Woodfords, Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas**, as detailed in the map attached **that may be required due to extreme weather conditions that increase the risk of a potential wildfire.**

Liberty has activated its PSPS protocol and has alerted public safety partners, Medical Baseline Customers, all customers that may be impacted, and other key audiences regarding the possibility of a PSPS.

Here's what you need to know:

- **Expected start of PSPS outage:** Friday, November 22, at 5:00 a.m.
- **Expected duration of PSPS outage:** from 7-24 hours
- **Number of customers potentially impacted:** Approximately 1,490 customers may be impacted by Liberty's potential PSPS. See map for details.

Liberty will activate two Community Resource Centers on Friday, November 22 from 8 a.m. – 10 p.m. The Woodfords Community Center, 96 Washoe Blvd., Markleeville, CA and Walker Community Center, 442 Mule Deer Drive, Walker, CA that will remain open throughout the PSPS. Liberty will also provide regular updates to customers via [website](#), email, social media, and Onsolve (text/phone platform).

In addition, [here is the website with PSPS information in multiple languages](#).

Thank you for your support and cooperation as we work to keep our customers and communities safe.

About Public Safety Power Shutoffs

A public safety power shutoff (PSPS) is a safety procedure utilized by electric utilities to proactively turn off power when and where weather conditions create a high wildfire risk. The practice of de-energization, which is becoming more and more frequent, is supported by the California Public Utilities Commission (CPUC) as a safety best practice.

In partnership with fire weather experts, Liberty monitors real-time weather data and forecasts and regularly tests fuel moisture during the fire season. If forecasted conditions meet or exceed safety thresholds, Liberty may initiate a PSPS.

Microsoft Teams [Need help?](#)

[Join the meeting now](#)

Meeting ID: 246 255 818 705

Passcode: 8o3QT3Wd

Dial in by phone

[+1 323-553-3604,,785958569#](#) United States, Los Angeles

[Find a local number](#)

Phone conference ID: 785 958 569#

For organizers: [Meeting options](#) | [Reset dial-in PIN](#)

16 Appendix C – CPUC Notifications

From: [Jordan Parrillo](#)
To: [DeMayo, Ronald](#); [Noll, Anthony](#); [Palmer, Leslie L.](#); pspsnotification@cpuc.ca.gov
Cc: [Dan Marsh](#); [Sharon Yang](#); [Peter Stoltman](#); [Tracy Luu-Varnes](#); [Nicholas Raft](#); [Manasa Rao](#)
Subject: Liberty Restores Power to All Customers Following Public Safety Power Shutoff Event
Date: Friday, November 22, 2024 10:54:00 PM

Good evening,

Liberty Utilities (Liberty) has restored power to all customers impacted by the Public Safety Power Shutoff (PSPS) event in the Markleeville, Woodfords, Desolation Hotel (Hope Valley), and Walker areas. Liberty crews conducted safety inspections on the affected power lines before safely re-energizing those customers by 9:47 p.m. on November 22, 2024.

Our team will soon begin development of the post-PSPS report using the data we collected throughout the event and submit the document to the California Public Utilities Commission by the required date.

Thank you for your support throughout this public safety event.

Sincerely,
Jordan

Jordan Parrillo | [Liberty Utilities \(California\)](#) | Manager, Regulatory Affairs
P: 530-721-7818 | E: Jordan.Parrillo@libertyutilities.com

From: Jordan Parrillo
Sent: Friday, November 22, 2024 3:26 PM
To: DeMayo, Ronald <Ronald.DeMayo@cpuc.ca.gov>; Noll, Anthony <Anthony.Noll@cpuc.ca.gov>; Palmer, Leslie L. <Leslie.Palmer@cpuc.ca.gov>; pspsnotification@cpuc.ca.gov
Cc: Dan Marsh <Dan.Marsh@libertyutilities.com>; Sharon Yang <Sharon.Yang@libertyutilities.com>; Peter Stoltman <Peter.Stoltman@libertyutilities.com>; Tracy Luu-Varnes <Tracy.Luu-Varnes@libertyutilities.com>; Nicholas Raft <Nicholas.Raft@libertyutilities.com>; Manasa Rao <Manasa.Rao@libertyutilities.com>
Subject: Update Regarding Liberty Public Safety Power Shutoff Event

Good afternoon,

Liberty Utilities (Liberty) is notifying the California Public Utilities Commission that we initiated a Public Safety Power Shutoff (PSPS) in the Walker area to reduce wildfire risk and ensure the safety of the community during forecasted extreme weather conditions.

Pertinent details:

- The Muller 1296 circuit remains de-energized.
- The southern portions of the Topaz 1202 circuit were de-energized at 1:26 p.m. due to extreme weather conditions.

Approximately 1,041 customers, including 12 Medical Baseline (MBL) customers and 133 other access and functional needs (AFN) customers, are impacted.

- Link to Liberty PSP portal: [Liberty Utilities - PSPS Operations App | Liberty Utilities Public Safety](#)
- Liberty will keep both Community Resource Centers (CRC) open on Friday, November 22 from 8 a.m. – 10 p.m. One CRC is located at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA 96120 and one CRC is located at Walker Community Center, 442 Mule Deer Drive, Walker, CA 93517.

We will continue to monitor weather conditions as they evolve and keep you apprised of any significant updates.

Thank you for your support and cooperation as we work to keep our communities safe.

Sincerely,
Jordan

Jordan Parrillo | Liberty Utilities (California) | Manager, Regulatory Affairs
P: 530-721-7818 | E: Jordan.Parrillo@libertyutilities.com

From: Jordan Parrillo

Sent: Friday, November 22, 2024 9:19 AM

To: DeMayo, Ronald <Ronald.DeMayo@cpuc.ca.gov>; Noll, Anthony <Anthony.Noll@cpuc.ca.gov>; Palmer, Leslie L. <Leslie.Palmer@cpuc.ca.gov>; pspsnotification@cpuc.ca.gov

Cc: Dan Marsh <Dan.Marsh@libertyutilities.com>; Sharon Yang <Sharon.Yang@libertyutilities.com>; Peter Stoltman <Peter.Stoltman@libertyutilities.com>; Tracy Luu-Varnes <Tracy.Luu-Varnes@libertyutilities.com>; Nicholas Raft <Nicholas.Raft@libertyutilities.com>; Manasa Rao <Manasa.Rao@libertyutilities.com>

Subject: Update Regarding Liberty Public Safety Power Shutoff Event

Good morning,

Liberty Utilities (Liberty) is notifying the California Public Utilities Commission that due to improved conditions, Liberty has restored power to customers in the Topaz, Coleville, and Walker areas.

Pertinent details:

- The Muller 1296 circuit remains de-energized and Liberty continues to closely monitor weather conditions on the Topaz 1202 circuit.
- Approximately 686 customers, including 2 Medical Baseline (MBL) customers and 191 other access and functional needs (AFN) customers, remain impacted.
- Link to Liberty PSP portal: [Liberty Utilities - PSPS Operations App | Liberty Utilities Public Safety](#)
- Liberty will keep both Community Resource Centers (CRC) open on Friday, November 22 from 8 a.m. – 10 p.m. One CRC is located at the Woodfords Community Center, 96 Washoe Blvd,

Markleeville, CA 96120 and one CRC is located at Walker Community Center, 442 Mule Deer Drive, Walker, CA 93517.

We will continue to monitor weather conditions as they evolve and keep you apprised of any significant updates.

Thank you for your support and cooperation as we work to keep our communities safe.

Sincerely,
Jordan

Jordan Parrillo | Liberty Utilities (California) | Manager, Regulatory Affairs
P: 530-721-7818 | E: Jordan.Parrillo@libertyutilities.com

From: Jordan Parrillo

Sent: Friday, November 22, 2024 8:06 AM

To: DeMayo, Ronald <Ronald.DeMayo@cpuc.ca.gov>; Noll, Anthony <Anthony.Noll@cpuc.ca.gov>; Palmer, Leslie L. <Leslie.Palmer@cpuc.ca.gov>; pspsnotification@cpuc.ca.gov

Cc: Dan Marsh <Dan.Marsh@libertyutilities.com>; Sharon Yang <Sharon.Yang@libertyutilities.com>; Peter Stoltman <Peter.Stoltman@libertyutilities.com>; Tracy Luu-Varnes <Tracy.Luu-Varnes@libertyutilities.com>; Nicholas Raft <Nicholas.Raft@libertyutilities.com>; Manasa Rao <Manasa.Rao@libertyutilities.com>

Subject: Public Safety Power Shutoff Initiated by Liberty

Good morning,

Liberty Utilities (Liberty) is notifying the California Public Utilities Commission that we initiated a Public Safety Power Shutoff (PSPS) in the Markleeville, Woodfords, and Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas to reduce wildfire risk and ensure the safety of the community during forecasted extreme weather conditions.

Pertinent details:

- Muller 1296 Circuit and Topaz 1202 Circuit were de-energized starting at 8:00 a.m.
- Extreme weather conditions are forecasted for the aforementioned areas between 8:00 a.m. and 8:00 p.m. on 11/22/2024.
- Approximately 1,491 customers, including 15 Medical Baseline (MBL) customers and 399 other access and functional needs (AFN) customers, are impacted.
- Public safety partners and Liberty customers have been contacted.
- Link to Liberty PSP portal: [Liberty Utilities - PSPS Operations App | Liberty Utilities Public Safety](#)
- Liberty has activated two Community Resource Centers (CRC) on Friday, November 22 from 8 a.m. – 10 p.m. One CRC is located at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA 96120 and one CRC is located at Walker Community Center, 442 Mule Deer Drive, Walker, CA 93517.

We will continue to monitor weather conditions as they evolve and keep you apprised of any significant updates.

Thank you for your support and cooperation as we work to keep our communities safe.

Sincerely,
Jordan

Jordan Parrillo | Liberty Utilities (California) | Manager, Regulatory Affairs
P: 530-721-7818 | E: Jordan.Parrillo@libertyutilities.com

From: Jordan Parrillo

Sent: Thursday, November 21, 2024 3:28 PM

To: DeMayo, Ronald <Ronald.DeMayo@cpuc.ca.gov>; Noll, Anthony <Anthony.Noll@cpuc.ca.gov>; Palmer, Leslie L. <Leslie.Palmer@cpuc.ca.gov>; pspsnotification@cpuc.ca.gov

Cc: Dan Marsh <Dan.Marsh@libertyutilities.com>; Sharon Yang <Sharon.Yang@libertyutilities.com>; Peter Stoltman <Peter.Stoltman@libertyutilities.com>; Tracy Luu-Varnes <Tracy.Luu-Varnes@libertyutilities.com>; Nicholas Raft <Nicholas.Raft@libertyutilities.com>; Manasa Rao <Manasa.Rao@libertyutilities.com>

Subject: Potential Public Safety Power Shutoff Event - Monitoring

Good afternoon,

Liberty Utilities (Liberty) is notifying the California Public Utilities Commission that we are still monitoring extreme weather conditions and may implement a Public Safety Power Shutoff (PSPS) in the Markleeville, Woodfords, and Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas within the next 24 hours to reduce wildfire risk and ensure the safety of the community during the anticipated extreme weather conditions.

The pertinent details below have not changed:

- Extreme weather conditions are forecasted for the aforementioned areas starting November 22, 2024 at 5:00 a.m.
- Approximately 1,491 customers, including 15 Medical Baseline (MBL) customers and 399 other access and functional needs (AFN) customers, could be impacted.
- Public safety partners and Liberty customers have been contacted.
- Link to Liberty PSP portal: [Liberty Utilities - PSPS Operations App | Liberty Utilities Public Safety](#)
- Liberty will activate two Community Resource Centers (CRC) on Friday, November 22 from 8 a.m. – 10 p.m. One CRC will be located at the Woodfords Community Center, 96

Washoe Blvd, Markleeville, CA 96120 and one CRC will be located at Walker Community Center, 442 Mule Deer Drive, Walker, CA 93517.

We will continue to monitor weather conditions as they evolve and keep you apprised of any significant updates.

Thank you for your support and cooperation as we work to keep our communities safe.

Sincerely,
Jordan

Jordan Parrillo | Liberty Utilities (California) | Manager, Regulatory Affairs
P: 530-721-7818 | E: Jordan.Parrillo@libertyutilities.com

From: Jordan Parrillo

Sent: Thursday, November 21, 2024 9:18 AM

To: DeMayo, Ronald <Ronald.DeMayo@cpuc.ca.gov>; Noll, Anthony <Anthony.Noll@cpuc.ca.gov>; Palmer, Leslie L. <Leslie.Palmer@cpuc.ca.gov>

Cc: Dan Marsh <Dan.Marsh@libertyutilities.com>; Sharon Yang <Sharon.Yang@libertyutilities.com>; Peter Stoltman <Peter.Stoltman@libertyutilities.com>; Tracy Luu-Varnes <Tracy.Luu-Varnes@libertyutilities.com>; Nicholas Raft <Nicholas.Raft@libertyutilities.com>

Subject: Potential Public Safety Power Shutoff Event

Good morning,

Liberty Utilities (Liberty) is notifying the California Public Utilities Commission that we may implement a Public Safety Power Shutoff (PSPS) in the Markleeville, Woodfords, and Desolation Hotel (Hope Valley), Topaz, Coleville, and Walker areas within the next 24 hours to reduce wildfire risk and ensure the safety of the community during the anticipated extreme weather conditions.

Pertinent details:

- Extreme weather conditions are forecasted for the aforementioned areas starting November 22, 2024 at 5:00 a.m.
- Approximately 1,491 customers, including 15 Medical Baseline (MBL) customers and 399 other access and functional needs (AFN) customers, could be impacted.
- Public safety partners and first responders will be contacted immediately and made aware of the medically sensitive customers who could be impacted if a PSPS is implemented.
- Link to Liberty PSP portal: [Liberty Utilities - PSPS Operations App | Liberty Utilities Public Safety](#)
- Liberty will activate two Community Resource Centers (CRC) on Friday, November 22

from 8 a.m. – 10 p.m. One CRC will be located at the Woodfords Community Center, 96 Washoe Blvd, Markleeville, CA 96120 and one CRC will be located at Walker Community Center, 442 Mule Deer Drive, Walker, CA 93517.

Customers who require power to operate life-essential medical equipment will be contacted and strongly encouraged to make special accommodations should a PSPS be implemented or dial 9-1-1 if they are unable to secure necessary alternative power.

We will continue to monitor weather conditions as they evolve and keep you apprised of any significant updates.

Thank you for your support and cooperation as we work to keep our communities safe.

Sincerely,
Jordan

Jordan Parrillo | [Liberty Utilities \(California\)](#) | Manager, Regulatory Affairs
P: 530-721-7818 | E: Jordan.Parrillo@libertyutilities.com

17 Appendix D - PSPS Event Data Workbook (Excel File)

Available at: <https://california.libertyutilities.com/portola/residential/safety/electrical/wildfire-mitigation.html>